



Programmable Terminal NA Series

Practice Guide IAG Library to Visualize Integration of Control and Safety

NA5-15□101□

NA5-12□101□

NA5-9□001□

NA5-7□001□

A large rectangular box with a vertical gradient from yellow at the top to orange at the bottom, containing the text "Practices Guide".

Practices
Guide

■ Introduction

This guide provides the reference information when creating and using IAG objects. It does not provide safety information. Be sure to obtain the NA Series Programmable Terminal User's Manual, to read the safety and other information necessary to use, and to test the equipment sufficiently before actual use.

Sysmac is the trademark or registered trademark of Omron Corporation in Japan and other countries for Omron factory automation products.

Company names and product names in this document are the trademarks or registered trademarks of their respective companies.

Screenshots are used with permission from Microsoft Corporation.

Terms and Conditions Agreements

Thank you for your usage of products of Omron Corporation (Omron). These terms and conditions shall be applied to all transactions regardless of who sells if there is no special agreement on the products.

- Definitions of Terms

- Omron product(s): Omron branded Factory Automation (FA) system equipment, general-purpose control devices, sensors, and electronic/mechanism components.
- Catalogues: Omron general catalogue "BEST", electronic/mechanism components general catalogue and other catalogues, specifications, instructions and manuals of Omron products, including electronically provided information available on the Omron electronic components information website, etc.
- Usage conditions: Usage conditions, rating, performance, operating environment, handling instructions, cautions, prohibited use, etc. of Omron products described in specifications, documentations or manuals.
- Customers application(s): Application of Omron products by customers which include embedding and/or using Omron products in their parts/components, electronic substrates, devices, equipment or systems manufactured by customers.
- Fitness: (a)Fitness, (b)performance, (c) non-infringement of third-party intellectual property, (d) compliance with laws and regulations and (e)conformity to various standards.

- Note about Descriptions

Attention is required to the following points for information obtained from Catalogues.

(1) Rated values and performance values are the product of tests performed for separate single conditions, including but not limited to temperature and humidity.

Omron does not warrant rated values and performance values for multiple combined conditions.

(2) Reference data are provided for reference only. Omron does NOT warrant that Omron products work properly at all times in the range of reference data.

(3) Application examples are provided for reference only. Omron does NOT warrant the fitness of Omron products under such applications.

(4) Omron may discontinue the production of Omron products or change the specifications of them for the purpose of improving such products or other reasons entirely at its own discretion.

● Note about Use

Please be aware of and accept the following when you introduce or use Omron products:

- (1) Please use Omron products in compliance with usage conditions including rating and performance limits.
- (2) Please confirm the fitness of Omron products in your application and use your own judgment to determine the appropriateness of using them in such application. Omron shall not warrant the fitness of Omron products in customer applications.
- (3) Please confirm in advance that Omron products are properly wired and installed for their intended use in your overall system.
- (4) When using Omron products, please make sure to (i) maintain a margin of safety between the published rated and performance values, and the application requirements, (ii) design to minimize risks to customer application in case of failure of Omron products, such as introducing redundancy, (iii) introduce system-wide safety measures to notify risks to users, and (iv) conduct regular maintenance on Omron products and customer application.
- (5) Omron assumes no responsibility for any direct or indirect loss, damage and expense resulting from infection of our products, installed software, any computer devices, computer programs, network, and databases with the followings:
 - DDoS attack (distributed DoS attack),
 - Computer virus and other technically harmful program, and
 - Unauthorized access.

Please conduct the followings by yourself: (i) antivirus software, (ii) data input/output, (iii) lost data recovery, (iv) protections against computer virus that contaminate Omron products or the installed software, and (v) measures to protect Omron products from unauthorized access.

(6) Omron products are designed and manufactured as general-purpose products for use in general industrial applications. They are not intended to be used in the following critical applications. If you are using Omron products in the following applications, Omron shall not provide any warranty for such Omron products, unless otherwise specifically agreed or unless the specific applications are intended by Omron.

(a) Applications with stringent safety requirements, including but not limited to nuclear power control equipment, combustion equipment, aerospace equipment, railway equipment, elevator/lift equipment, amusement equipment, medical equipment, safety devices and other applications that could cause danger/harm to people's body and life.

(b) Applications that require high reliability, including but not limited to supply systems for gas, water and electricity, etc., 24 hour continuous operating systems, financial settlement systems and other applications that handle rights and property.

(c) Applications under severe condition or in severe environment, including but not limited to outdoor equipment, equipment exposed to chemical contamination, equipment exposed to electromagnetic interference and equipment exposed to vibration and shocks.

(d) Applications under conditions and environment not described in specifications.

(7) In addition to the applications listed from (a) to (d) above, Omron products (see definition) are not intended for use in vehicles designed human transport (including two wheel vehicles). Please do NOT use Omron products for vehicles designed human transport. Please contact Omron sales representatives for information on our automotive line of products.

- Warranty Terms and Conditions

The terms and conditions for warranty of Omron products are as follows:

(1) Warranty Period: Warranty period is one year after the date of purchase.

However, it is excepted when there is an additional description in the catalogues.

(2) Coverage: Omron, at its own discretion, will provide one of the following two services for malfunctioning Omron products:

(a) Free repair of the malfunctioning Omron products at an Omron maintenance service location. No repair support is available for electronic components.

(b) Free replacement of the malfunctioning Omron products with the same number of replacement/alternative products.

(3) Exceptions: Omron will not cover Omron products under its warranty if the cause of the malfunction falls under any of the following.

(a) Usage in a manner other than the original intended use for the Omron products.

(b) Usage outside of the usage conditions.

(c) Usage of the product against the conditions described in □Note about Use□

(d) Modification or repair made to the Omron product by other than Omron personnel.

(e) Software program embedded by other than Omron or usage of such software.

(f) Cause which could not have been foreseen with the level of science and technology at the time of shipping from Omron.

(g) Causes originating from other than Omron or Omron products (including causes such as, but not limited to, natural disasters).

- Limitation of Liability

The warranty set out in these Terms and Conditions is the whole and sole liability for Omron products. There are no other warranties, expressed or implied. Omron and the distributors of Omron products are not liable for any damages which may arise from or be related to Omron products.

- Export Controls

Customers of Omron products shall comply with all applicable laws and regulations of Japan and/or other relevant countries with regard to security export control, when exporting Omron products and/or technical documents or providing such products and/or documents to a non-resident. Omron may not provide customers with Omron products and/or technical documents should they fail to comply with such laws and regulations.

Contents

Terms and Conditions Agreements	3
1 Related Manuals	8
2 Precautions	9
3 Overview	10
3-1 Overview	10
3-2 System Configuration	12
4 Library Version	13
5 Details of IAG Objects	14
5-1 ReadConfiguration	14
5-2 SignatureViewer	17
5-3 IOMonitor.....	30
5-4 RestoreFileDownload.....	37
5-5 DataLogFileDownload.....	50
5-6 DataLogFileView	62
5-7 SelectDataLogParameter	70
5-8 GraphDisplay.....	77
5-9 DataLogResultMeasurement	86
5-10 TroubleShooter.....	93
6 Structures	96
Revision History	97

1 Related Manuals

No.	Model	Title
V117	NA5-15W□□□□ NA5-12W□□□□ NA5-9W□□□□ NA5-7W□□□□	Programmable Terminal NA-series Hardware USER'S MANUAL
V118	NA5-15W□□□□ NA5-12W□□□□ NA5-9W□□□□ NA5-7W□□□□	Programmable Terminal NA-series Software USER'S MANUAL
V119	NA5-15W□□□□ NA5-12W□□□□ NA5-9W□□□□ NA5-7W□□□□	Programmable Terminal NA-series Device Connection USER'S MANUAL
V120	NA5-15W□□□□ NA5-12W□□□□ NA5-9W□□□□ NA5-7W□□□□	Programmable Terminal NA-series STARTUP GUIDE
W504	SYSMAC-SE2□□□	Sysmac Studio Version 1 OPERATION MANUAL
V447	NA5-15W□□□□ NA5-12W□□□□ NA5-9W□□□□ NA5-7W□□□□	Programmable Terminal NA-series Practice Guide Demonstration Screen for Safety CPU

2 Precautions

- (1) When building an actual system, check the specifications of the component devices of the system, use within the ratings and specified performance, and take safety measures such as safety circuits to minimize the possibility of an accident.
- (2) For safe use of the system, get the manuals of the component devices of the system and check the information in each manual, including “Safety Precautions” or “Precautions for Safe Use” before usage.
- (3) It is the responsibility of the customer to check all the laws, regulations, and standards that the system must comply with.
- (4) All rights reserved. No part of this publication may be reproduced, copied and redistributed without the prior written permission of Omron.
- (5) The information in this guide is current as of May 2019.
It is subject to change without notice because of product upgrade.
- (6) This IAG library has been tested with the system configuration in 3-2 “System Configuration.” However, Omron does not guarantee screen operations after embedding the IAGs.

Special information in this document is classified as follows:



Precautions for Safe Use

It describes precautions on what to do and what not to do to ensure safe usage of the product.



Precautions for Correct Use

It shows precautions on what to do and what not to do to ensure proper operation and performance.



Additional Information

It shows precautions on what to do and what not to do to ensure proper operation and performance.

Copyrights and Trademarks

Screenshots are used in accordance with Microsoft Corporation guidelines.

Windows and Visual Basic are the registered trademarks of Microsoft Corporation in the USA and other countries.

EtherCAT® is registered trademark and patented technology licensed by Beckhoff Automation GmbH.

Company names and product names in this document are the trademarks or registered trademarks of their respective companies.






3 Overview






3-1 Overview

This document describes IAG functions which read the information about a safety CPU and I/O units directly from NA series HMI without ladder programs, and how to use them.

- IAG external specifications
- Import and setting methods for IAG library
- IAG design structure

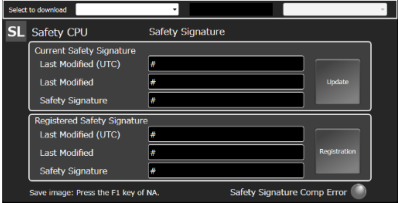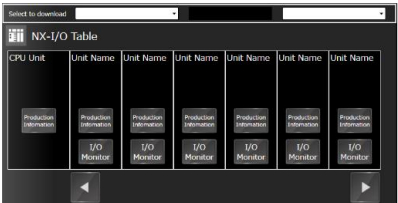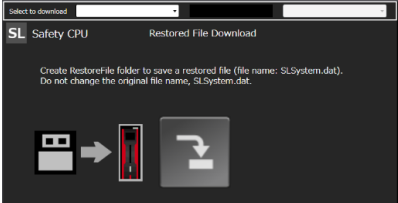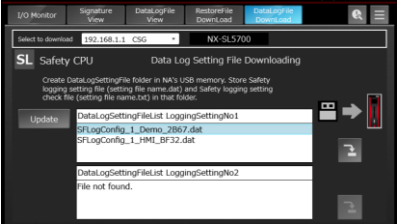Details about the following IAG objects are explained in this document.

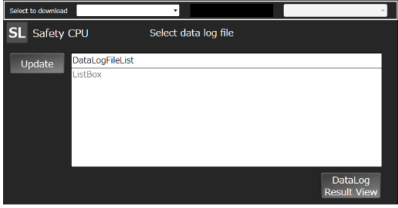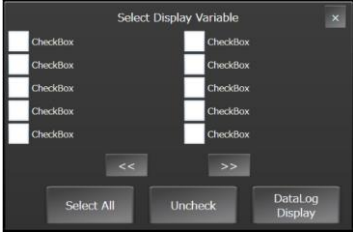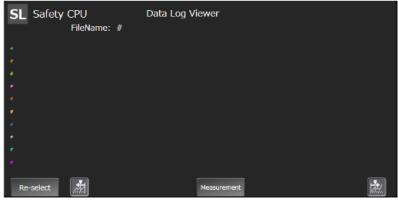Object	Icon	Description
ReadConfiguration		The configuration information about controllers connected with NA is read when this button is pressed.
SignatureViewer		Safety signature information of the safety CPU unit is read and registered on this screen.
IOMonitor		Controller I/O tables are displayed.
RestoreFileDownload		The safety CPU unit restored file is downloaded to a controller.
DataLogFileDownload		The safety CPU unit data log setting is downloaded to a controller.

DataLogFileView		The data log file of the safety CPU unit is displayed on this screen.
SelectDataLogParameter		The data log variables are displayed on this screen. The selected variables are shown in Data Log Viewer (GraphDisplay).
GraphDisplay		The result of data logging is depicted on this screen graphically.
DataLogResultMeasurement		The data logging result is measured.
TroubleShooter		The safety CPU unit trouble shooter is displayed when this button is pressed.

The following two files contain those IAGs.


File	Icon	Description
SafetyCPU_IAG_7inch.iag	7/ 9-inch	
SafetyCPU_IAG_12inch.iag	12/ 15-inch	

Ask the Omron sales representative to get the files.

The description and introduction procedure about IAG objects are for 7-inch display. The contents except IAG objects are the same. When you create screens for 12-inch NA, the IAG objects in this document should be replaced as necessary.

3-2 System Configuration

The IAG objects were tested with the system configuration and versions below.

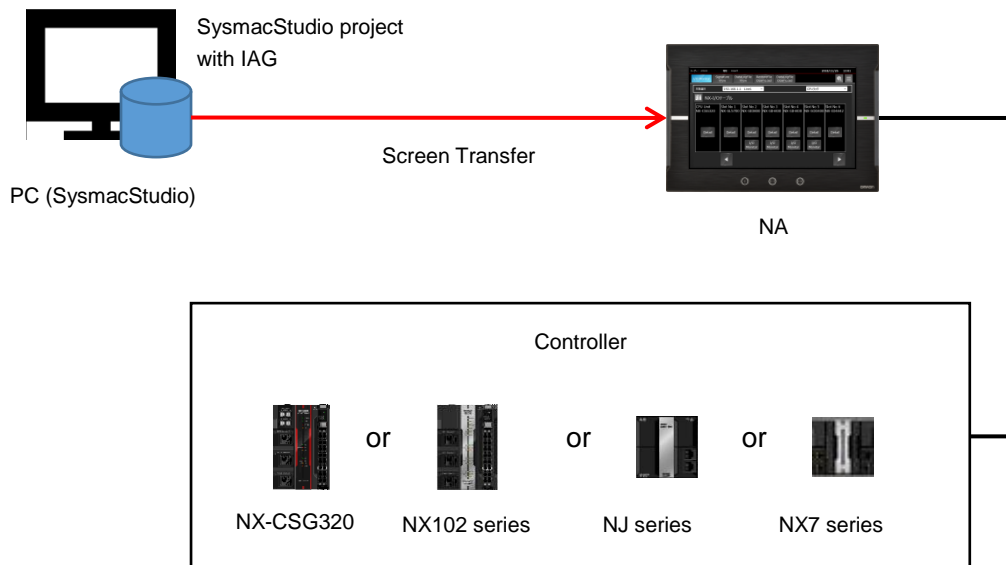

Tested versions are the following:

- NA OS : 7.2.1
- NA: 1.10
- SysmacStudio: 1.25
- Distribution file: 1.50*
- NX-CSG320: 1.00
- NX102-□□□□: 1.31
- NJ□□□-□□□□: 1.18
- NX7-□□□□: 1.18

*: See Chapter 4, "Library Version" for details.

Precautions for Correct Use

Omron tested the operation of this library. However, its quality is not guaranteed because it is a sample product. Confirm that the library operates properly with your equipment before use.

4 Library Version

This chapter describes the versions of related items with IAG library.

You should check versions of the items listed in the table below before using the library.

Item	Description	How to Check the Version
Distribution file	The distributed IAG files have the library versions.	The version can be checked in the SysmacStudio IAG Collections Manager pop-up.
IAG library	Version of each IAG library. It manages specification change, bug correction, and others.	IAG project file editing function in SysmacStudio. The version can be checked as an IAG property in IAG Collections Manager. Also in Properties after located as an object.
NA	The version of the NA with which IAG has been created. IAG library is NOT applicable to older versions than that in this guide because supported functions depend on versions.	See [Minimum supported HMI version] in IAG Collections Manager.
NA OS	The version which NA runtime can operate. It differs according to the NA runtime version.	System Menu of NA. It will be checked if necessary when you upgrade NA runtime version of a project in SysmacStudio.

The versions of IAG library, NA runtime, and OS in “Practice Guide IAG Library to Visualize Integration of Control and Safety (V448)” are as the following.

Item	Version	Remarks
Distribution file	Ver. 1.50	Filename extension is “.iag”.
IAG library	Noted individually	Refer to Chapter5 “Properties”.
NA	Ver. 1.10 and above	
NA OS	Ver. 7.2.1 and above	

The updated contents of IAGs due to distribution file update (ver. 1.40 to 1.50) are listed in the table below.



IAG	Version	Updated Content
ReadConfiguration	1.1→1.2	NX7 and NJ series supported.
SignatureViewer	1.2→1.3	The security function improved.
IOMonitor	1.4→1.5	Displayed content in the LED Monitor Screen updated.
DataLogFileDownload	1.3→1.4	Bugs fixed.
DataLogFileView	1.3→1.4	Bugs fixed.。

5 Details of IAG Objects

5-1 ReadConfiguration

5-1-1 Specifications

● External Specification


Object Name	ReadConfiguration
Category	SafetyCPU
Description	Reads out configuration information when the screen with this IAG appears for the first time. Set the screen, which contains this IAG, to be displayed first.
Function	Reads configuration information about controllers that connected with NA. Up to 16 safety CPU units can be connected.
Graphic	Before reading 
	After reading 

● Properties

Property	Description	Input Mode	Input Range/ Data Type	Default
General				
Name	Object name. Must not be overlapped in a screen.	Direct input	Character string (1 to 127)	ReadConfiguration0
Type	Object type. Not changeable.	-	-	SafetyCPU_IAG_7inch.ReadConfiguration
Version	IAG version	-	-	1.2.0.0
Publisher	IAG publisher	-	-	Omron Promotion Sample
Appearance				
Background Color	Background color of a page	Item selection Direct input	Color pallet Character string	Transparent *1
Layout				
▼Position (Left , Top)	Position setting of object on a page. ²	Direct input Spin button	Numeric Numeric	-
Left	Horizontal position (X-axis) of the top-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
Top	Vertical position (Y-axis) of the to-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
▼Size (Width, Height)	Object size setting.	Direct input Spin button	Numeric Numeric	(100,50)
Width	Width of object	Direct input Spin button	Numeric Numeric	100
Height	Height of object.	Direct input Spin button	Numeric Numeric	50
Input				
ReLoad	Re-reading configuration.	Variable specification	Boolean	(Blank)

Property	Description	Input Mode	Input Range/ Data Type	Default
Input/Output				
ControllerName	Controller name of the connected unit	Variable specification	String(15)	(Blank)
CheckController	Check flag for unit connected with the safety CPU unit.	Variable specification	Boolean(15)	(Blank)
SafetyCPUPosition	Place to where the safety CPU unit is connected.	Variable specification	String(15)	(Blank)
SelectUnitNo	The number of selected unit.	Variable specification	Short	(Blank)
FinishReadConfiguration	Completion flag for configuration reading	Variable specification	Boolean	(Blank)

Image

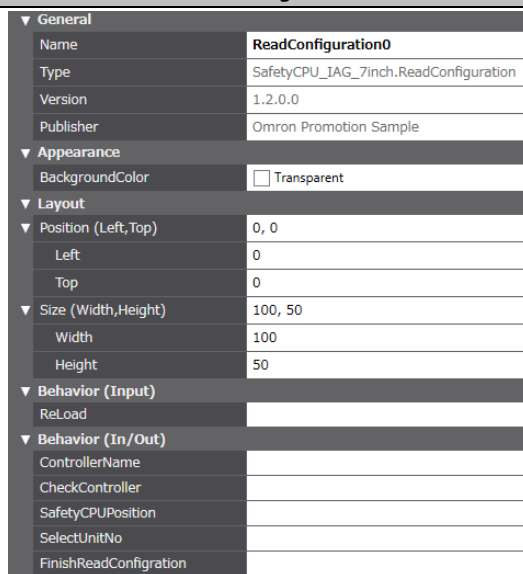

1: Transparent.

2: The origin of coordinates locates at the top left corner of NA screen.



Precautions for Correct Use


Be sure to use this IAG because the controller configuration which this IAG acquires is used for other IAGs; they may not operate properly.

- Events & Actions

No event & action function available.

- Animations

Basic motions of animation can be defined.

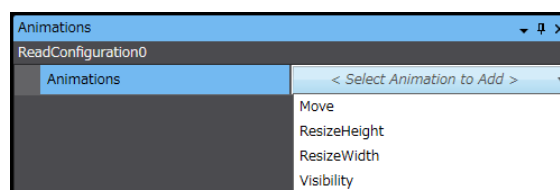

- Security


No security function is available.

5-1-2 Installation to Screen

● Property Assignment

This IAG reads out safety configuration information. The information is used for other IAGs. Be sure to place ReadConfiguration IAG in the first displayed screen. Assign variables to the following properties (input/output) to share the safety configuration information.





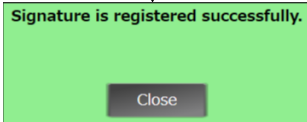
Property (Input/Output)	Description	Data Type
ControllerName	Controller name of connected unit	String(15)
CheckController	Check flag for unit connected with the safety CPU unit.	Boolean(15)
SafetyCPUPosition	Place to where the safety CPU unit is connected.	String(15)
SelectUnitNo	The number of selected unit.	Short
FinishReadConfiguration	Completion flag for configuration reading	Boolean

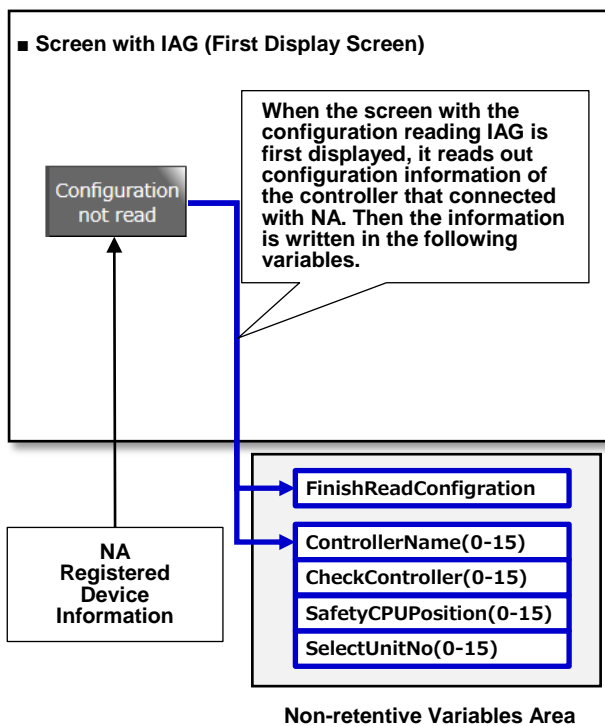


5-2 SignatureViewer

5-2-1 Specifications


- External Specification

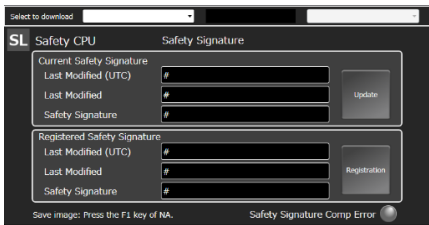Object Name	SignatureViewer
Category	SafetyCPU
Description	Registers safety signatures on NA. Safety signatures on the safety CPU and NA can be checked against each other to confirm if they are not fabricated unintentionally.
Function	<ul style="list-style-type: none"> ● Reads and registers a safety signature of the safety CPU unit. [Update] Reads out safety signature information of the connected safety CPU unit. [Register] Registers a safety signature on an IAG variable. The signature can be registered on up to 16 safety CPU units. ● Only one user is authorized to register the safety signature information.
Graphics	<p>This IAG consists of one screen and four pop-ups.</p> <ul style="list-style-type: none"> ■ Main Screen  ■ Signature Mismatch  ■ Password Validation  ■ No Authorized User Found  ■ Registration Completion  <p>Safety signatures are always checked inside after registered.</p>

● Screen Specifications

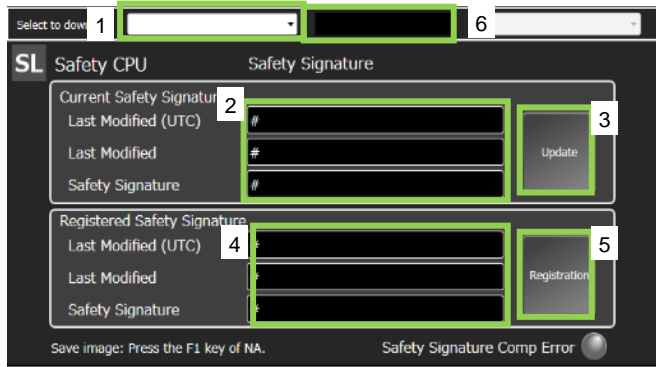
Main Screen	<p>On this screen, you can register safety signature and display the current value. Also you can display pop-up windows if necessary.</p> 
-------------	--

User I/F Specification		
No	Part	Description
1	DropDown	Selects the controller to display its safety signature information. Displays the safety signature, that of the selected controller, in the box2.
2	Data Display	Displays safety signature information obtained by the safety CPU unit.
3	Button	Updates safety signature information.
4	Data Display	Displays safety signature information that registered on NA.
5	Button	Registers safety signature information of the safety CPU on NA.
6	Data Display	Displays the model of the connected safety CPU.
Layout		
Property	Default	Description
Position (Left, Up)		Set in Property.
Size (Width, Height)		Set in Property.

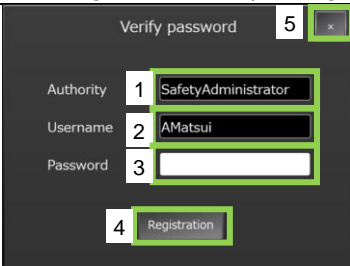Password Validation Screen	<p>This screen requires a password at safety signature registration.</p> <p>Press the Register button on Main screen to display this pop-up.</p> <p>Safety signature is registered according to the security setting of NA, after login.</p>
	


User I/F Specification		
No	Part	Description
1	Data Display	Authority given to the user displayed in the [2] box is displayed.
2	Data Display	Username allocated to the input variable <i>RegisteredUserName</i> is displayed.
3	Data Edit	User password is entered here.
4	Button	Executes login processing.
5	Button	Closed this pop-up.

Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

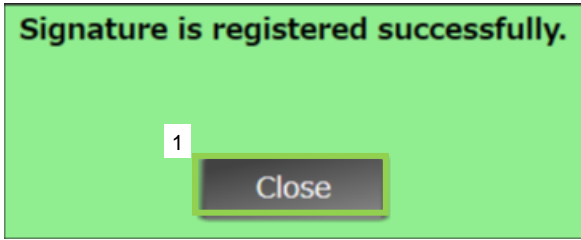
Registration Completion Screen	<p>The pop-up notifies that registration of safety signature has been completed. It doesn't normally appear.</p> <p>After the Register button is pressed, the screen appears in consequence of registration of safety signature.</p>
	

User I/F Specification		
No	Part	Description
1	Button	Closes this pop-up.

Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

Signature Mismatch Screen	This screen shows that the current safety signature is different from the registered value. It doesn't appear under a normal condition; it is displayed when a mismatch is detected.
	


User I/F Specification		
No	Part	Description
1	Button	Closes this pop-up.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

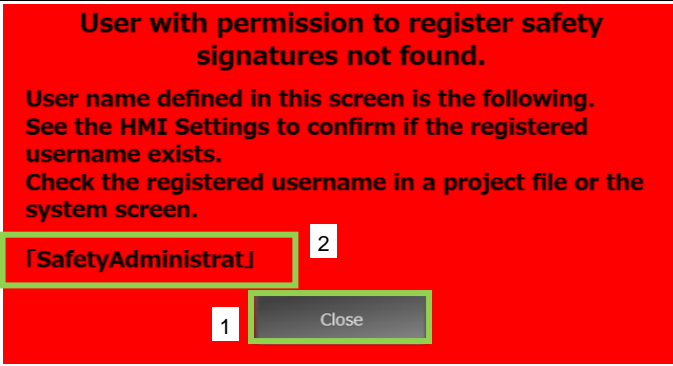No Authorized User Found Screen	It shows the message telling that the user who is permitted to register the safety signature is not registered on the security setting of the project file.
	This screen is usually not seen. It appears if the authorized user does not exist when the safety signature is registered.
	

User I/F Specification		
No	Part	Description
1	Button	Closes this pop-up.
2	Data Display	Registered authorized user's name is displayed. The value of this IAG's input variable, <i>RegisteredUserName</i> , is shown.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

● Properties

Property	Description	Input Mode	Input Range/ Data Type	Default
General				
Name	Object name. Must not be overlapped in a screen.	Direct input	Character string (1 to 127)	SignatureViewer0
Type	Object type. Not changeable.	-	-	SafetyCPU_IAG_7inch. SignatureViewer
Version	IAG version	-	-	1.3.0.0
Publisher	IAG publisher	-	-	Omron Promotion Sample
Appearance				
Background Color	Background color of a page	Item selection Direct input	Color pallet Character string	Transparent ¹
Layout				
▼Position (Left , Top)	Position setting of object on a page. ²	Direct input Spin button	Numeric Numeric	-
Left	Horizontal position (X-axis) of the top-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
Top	Vertical position (Y-axis) of the to-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
▼Size (Width, Height)	Object size setting.	Direct input Spin button	Numeric Numeric	(760,390)
Width	Width of object	Direct input Spin button	Numeric Numeric	760
Height	Height of object.	Direct input Spin button	Numeric Numeric	390
Input				
FinishReadConfiguration	Completion flag for configuration reading	Variable specification	Boolean	(Blank)
RegisteredUserName	Username who is permitted to register the safety signature	Variable specification	String	(Blank)
Input/Output				
ControllerName	Controller name of connected unit	Variable specification	String(15)	(Blank)
CheckController	Check flag for unit connected with the safety CPU unit.	Variable specification	Boolean(15)	(Blank)
SafetyCPUPosition	Place to where the safety CPU unit is connected.	Variable specification	String(15)	(Blank)
SelectUnitNo	The number of selected unit.	Variable specification	Short	(Blank)
SignatureSetting	Flag for the registered signature which stored in NA.	Variable specification ³	Boolean(15)	(Blank)
NA_Signature	Signature information which stored in NA.	Variable specification ³	String(15)	(Blank)
NA_LastModified.UTC	UTC of the registered signature which stored in NA.	Variable specification ³	String(15)	(Blank)
NA_LastModified	Registration time of the registered signature which stored in NA.	Variable specification ³	String(15)	(Blank)

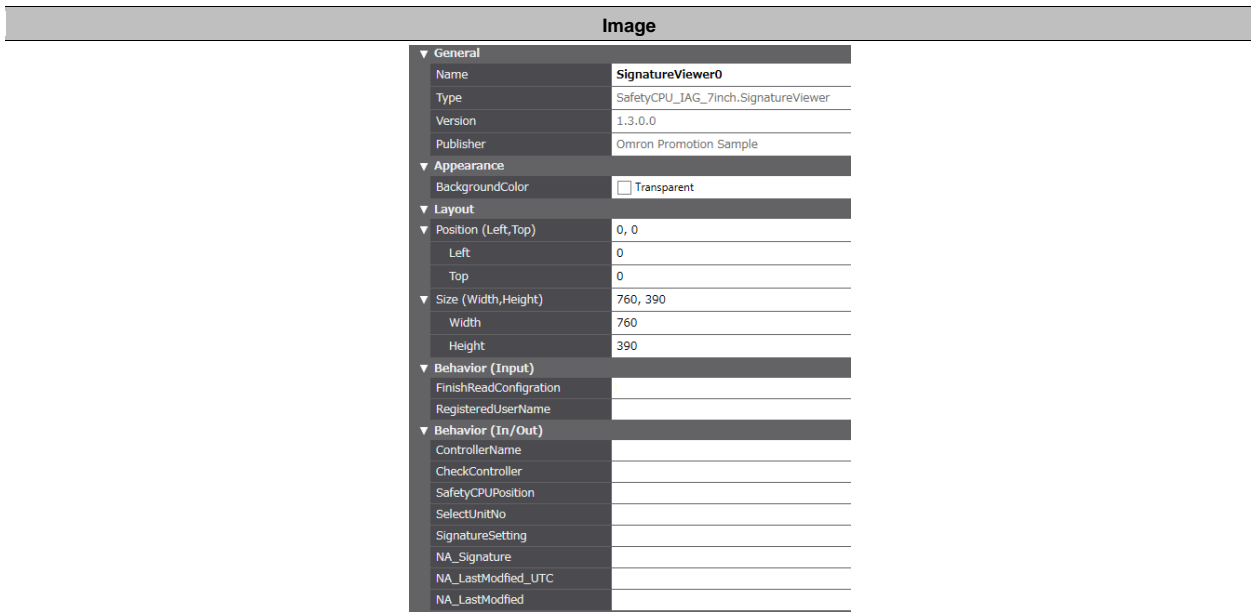


- 1: Transparent
- 2: The origin of coordinates locates at the top left corner of NA screen.
- 3: Allocated variables should be retentive.

● **Events & Actions**

No event & action function available.

● **Animations**

Basic motions of animation can be defined.

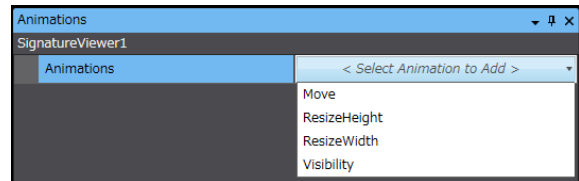

● **Security**

You are always required to login when pressing Registration. It is necessary to enter the registered Sysmac Studio user account name and password. You can log in with the user account which has been registered on *RegisteredUserName*, this IAG's input variable.



Precautions for Correct Use

This IAG does not work in the following cases:

- Any user account is not registered on the Security Setting of Sysmac Studio.
- The username which has been set to *RegisteredUserName* does not exist in the Security Setting.

● Property Assignment

This IAG uses the safety configuration information which has been read out by ReadConfiguration.


Be sure to place ReadConfiguration IAG in the first displayed screen. Assign variables to the following properties (input/output) to share the safety configuration information.

Property (Input)	Description	Data Type
FinishReadConfiguration	Completion flag for configuration reading	Boolean

Property (Input/Output)	Description	Data Type
ControllerName	Controller name of connected unit	String(15)
CheckController	Check flag for unit connected with the safety CPU unit.	Boolean(15)
SafetyCPUPosition	Place to where the safety CPU unit is connected.	String(15)
SelectUnitNo	The unit number of the selected unit.	Short

Allocate array variables which have been set to retentive to the following properties (Input/Output) in order to save each safety CPU unit safety signature data to NA.

Property (Input)	Description	Data Type
SignatureSetting	Flag for the registered signature which stored in NA.	Boolean(15)
NA_Signature	Signature information which stored in NA.	String(15)
NA_LastModified_UTC	UTC of the registered signature which stored in NA.	String(15)
NA_LastModified	Registration time of the registered signature which stored in NA.	String(15)

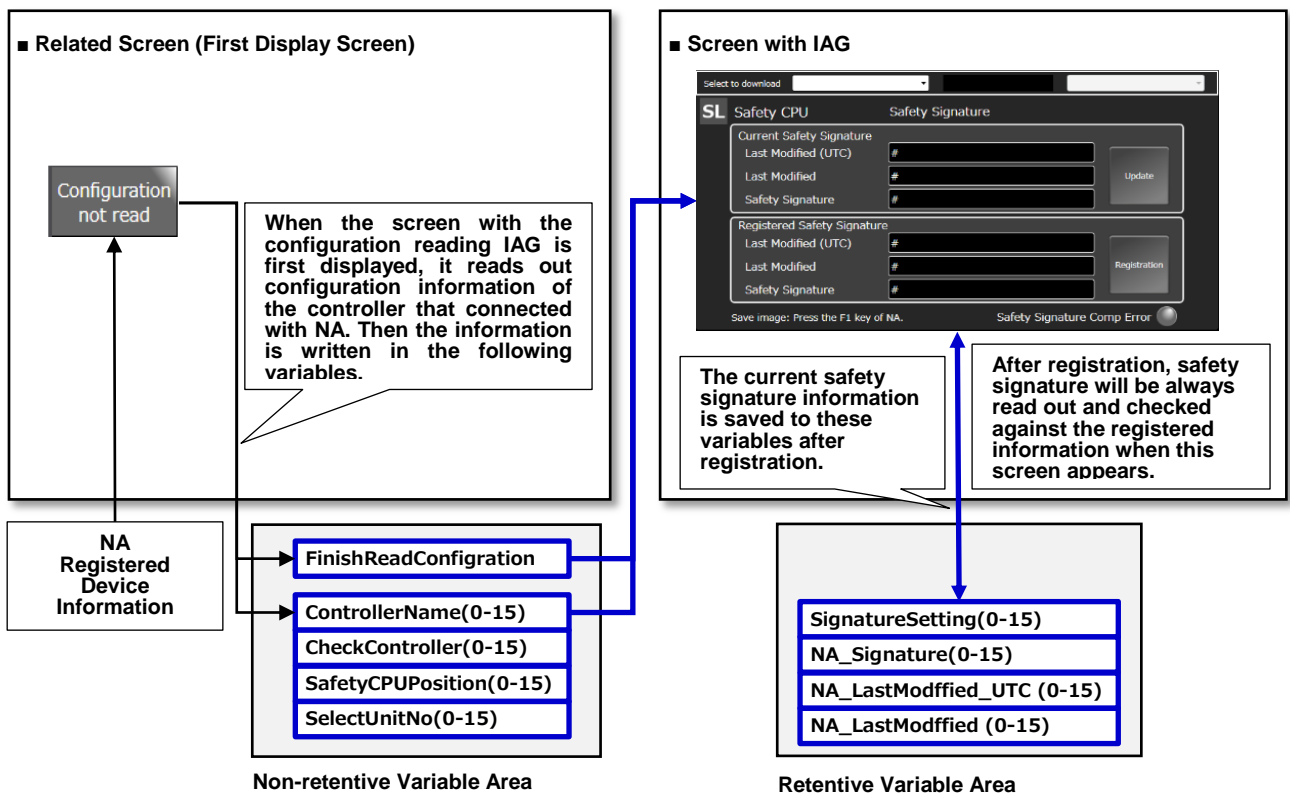


Precautions for Correct Use

- When multiple internal/ external devices are registered on a PJ file, they are allocated to Sysmac Studio Device Reference in registered order.
- If 16 and more devices are connected, only 16 can be assigned.

- Screen Transition

The figure below is a screen transition diagram with IAG objects.

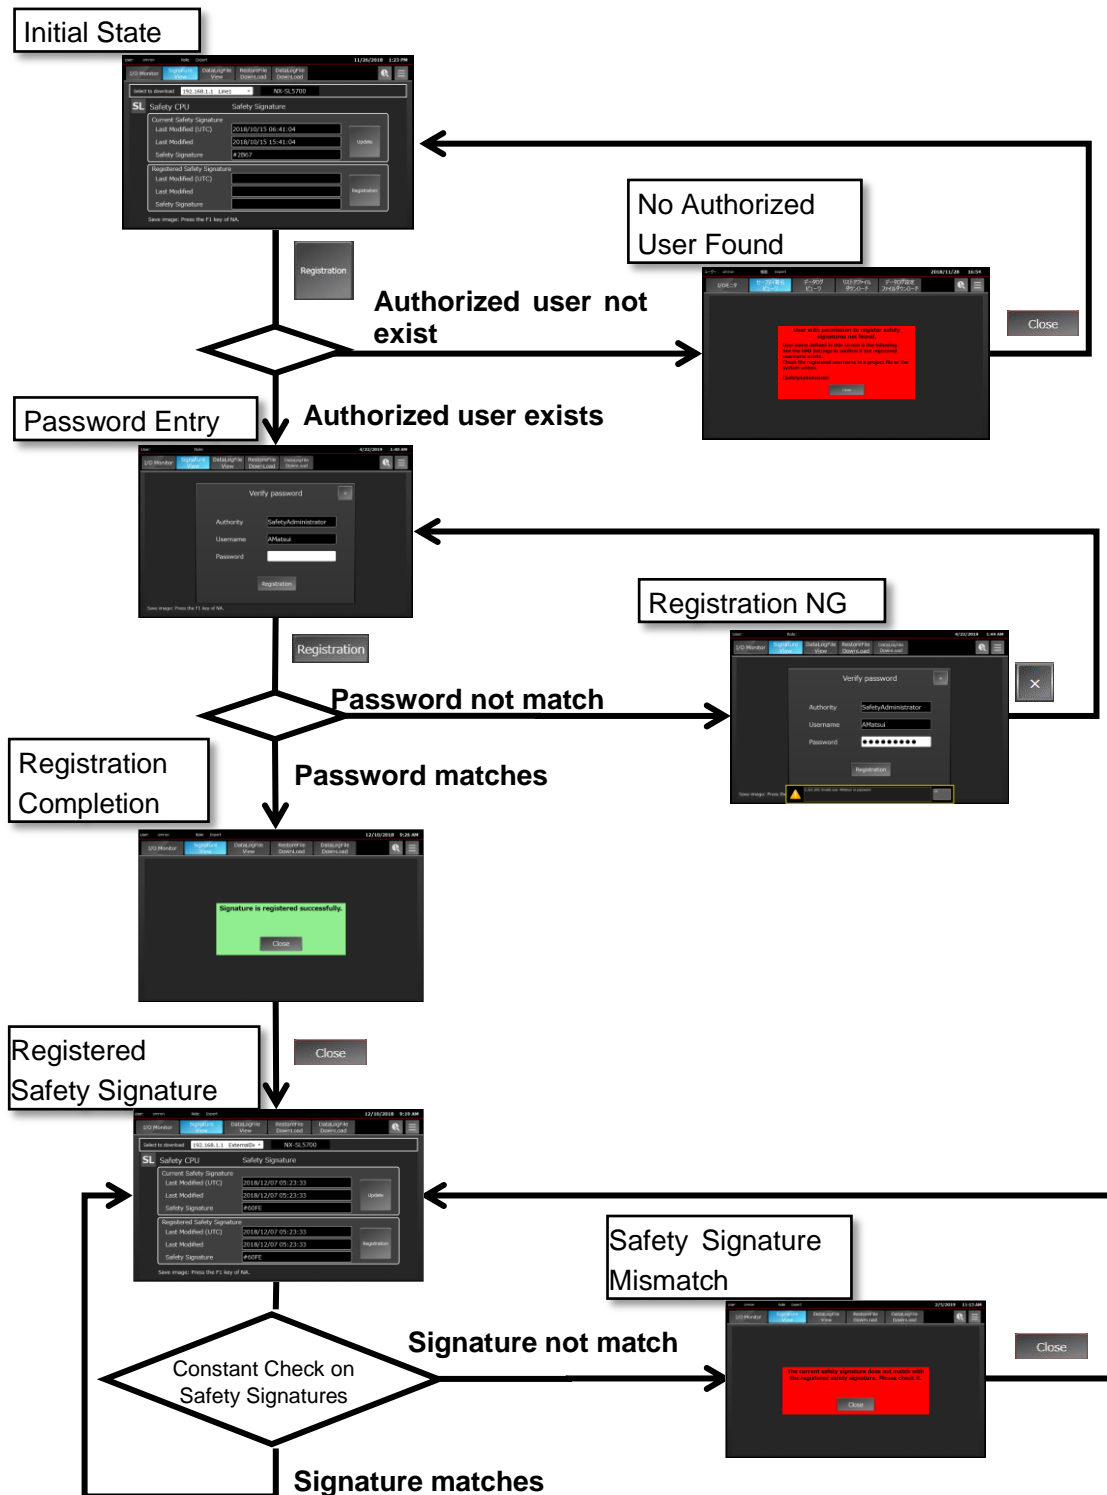

Customers will have to design screens if there is any necessary object except IAG objects.

5-2-3 Password Setting for Safety Program Administrator

When an administrator of the safety program manages the safety signature after equipment operation, an equipment designer must register an authority and a username first. Then, the safety program administrator will take over them. The administrator must change the password that the designer had registered at first to the new one. This section shows how to do it.


1. The equipment designer set the authority, login username, and temporary password as the safety program administrator designates. See “Security Setting for NA” for detailed procedure.
2. The designer tells the temporary password to the administrator when handing the equipment over. The administrator changes the password in the NA System Menu. Refer to “How to Change the Login Password to NA” for details.

● Security Setting for NA


When you register a safety signature, password authentication is required. You must configure the security setting of the NA before using this IAG.

Only the user whose name has been input to the variable *RegisteredUserName* is allowed to register the safety signature. The setting procedures for security and user on the NA are as the following.


1. Double-click [Configurations and Setup] – [Security Settings] in Multiview Explorer.

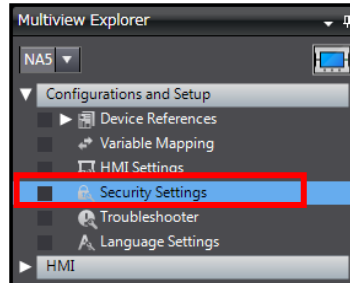


2. Click the [+] button enclosed in a red square, in [Roles and Access Levels].

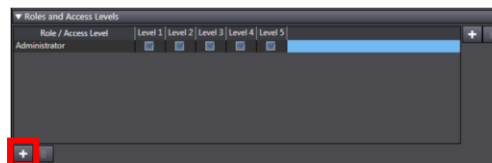


3. Enter an authority title and click to check the access level boxes.

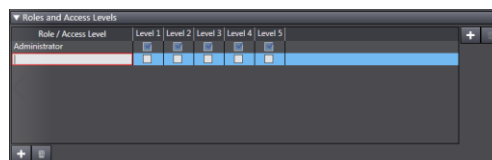


4. Click the [+] button enclosed in a red square, in [User Accounts].

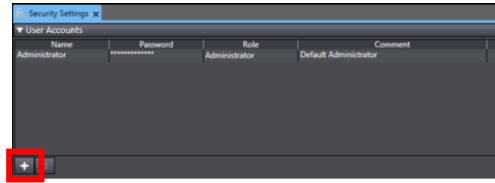


5. Enter Name, Password, and Role (authority).

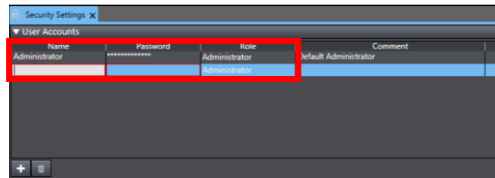

6. The right illustration is a sample setting. It permits the user "AMatsui" to register the safety signature.

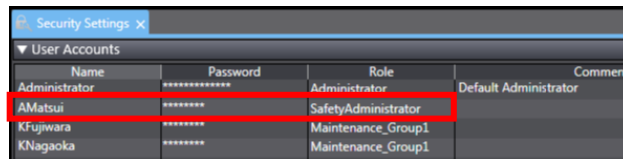

7. Double-click [HMI] – [Global Variables] in the Multiview Explorer.

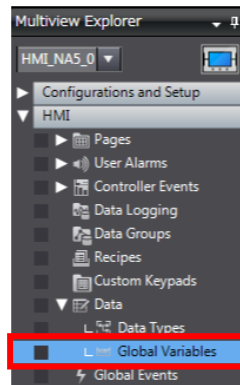


8. Create a variable according to the right illustration.

Name	Data Type	Initial Value
RegisteredUserName	String	'AMatsui'

Variable name:
RegisteredUserName
Data Type: String
Default: 'AMatsui'

9. Put this IAG on any screen. Then assign the variable *RegisteredUserName*, which you have created in the previous step, to the input variable *RegisteredUserName*.

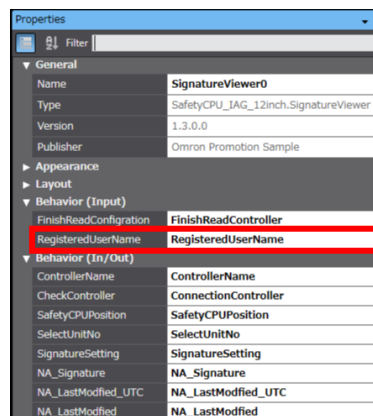


- How to Change the Login Password to NA

You can edit the user account information in the System Menu of the NA.

This section describes how to edit it with the configuration for the safety CPU demo screens.


1. Start the safety CPU demo screen. The screen shown in the right appears. Double-tap the upper-left corner of the screen.

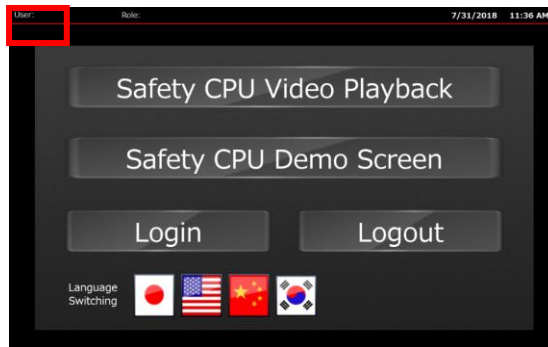


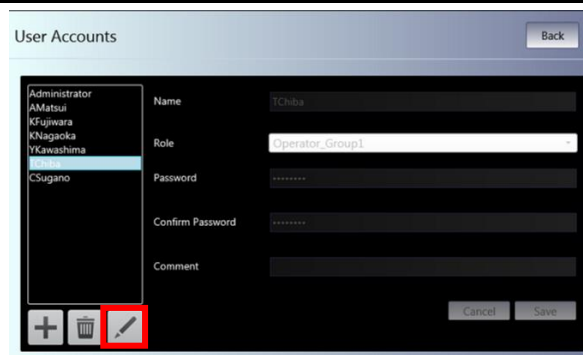
2. The System Menu is displayed. Touch the User Account icon.




3. The User Account Screen is displayed. Select the account you want to set.

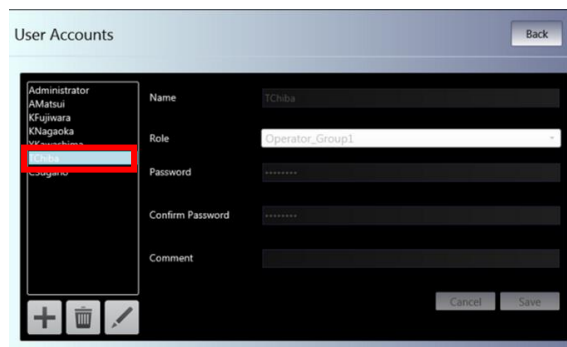

4. Touch the icon .




5. Enter a new password in the [Password] box. Type the password again in the [Confirm Password] box to confirm it.

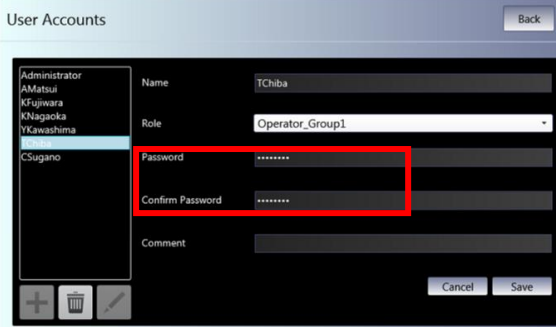

The screenshot shows the 'User Accounts' form. On the left is a list of users: Administrator, AMatsui, KFujiwara, KNagacka, YKawashima, and CSugano. The main form fields are: Name (TChiba), Role (Operator_Group1), Password (masked with asterisks), Confirm Password (masked with asterisks), and Comment. A red rectangle highlights the Password and Confirm Password fields. At the bottom right are 'Cancel' and 'Save' buttons.

6. Touch the Save button.

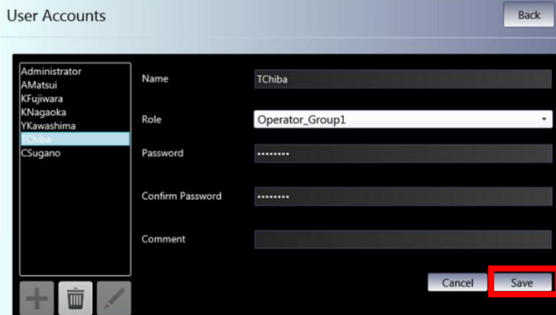

The screenshot shows the 'User Accounts' form, identical to the previous one. A red rectangle highlights the 'Save' button at the bottom right of the form.

5-3 IOMonitor

5-3-1 Specifications

- External Specification

Object Name	IOMonitor
Category	SafetyCPU
Function	Displays controller I/O tables. [I/O Monitor] Indicates input/output LED status of the safety I/O unit. [Production Information] Shows product information about the I/O unit. [▶] Displays the right-hand unit. [◀] Displays the left-hand unit.
Description	It enables to see the safety I/O unit LED status on NA without opening a control panel.
Graphics	<p>This IAG contains two screens and a pop-up.</p> <p>The diagram illustrates the IOMonitor interface. At the top is the Main Screen, which features a 'Select to download' dropdown menu and a table titled 'NX-I/O Table'. The table has columns for 'CPU Unit' and six 'Unit Name' columns. Below the table are navigation arrows (left and right) and buttons for 'Production Information' and 'I/O Monitor'. Arrows point from the 'I/O Monitor' button to the I/O LED Monitor screen, which shows a grid of yellow and grey squares representing LED status. Another arrow points from the 'Production Information' button to the Production Information Screen, which is a pop-up window displaying fields for Slot No, Model, Unit Version, Lot Number, Serial Number, and Hardware Version, each followed by a '#' symbol.</p>

● Screen Specifications


Main Screen	Displays I/O tables of the selected controller.

User I/F Specification		
No	Part	Description
1	DropDown	The button is used to select a controller to display its I/O tables. You can select the controller from the drop down list.
2	DropDown Button	Enables to select the I/O table to display in [3] on the screen.
3	Data Display	I/O tables of the connected controllers are displayed in this area.
4	Button	Displays product information on the selected unit. This button supports controller units (NX102 series, CSG series) and safety I/O units (NX-SI series, NX-SO series). Regular NX-I/O units are not supported.
5	Button	The screen is changed to the selected slot number safety I/O monitor screen by pressing this button. It supports safety I/O units (NX-SI series, NX-SO series), but not regular NX-I/O units.
Layout		
Property	Default	Descripton
Position (Left, Up)		Set in Property.
Size (Width, Height)		Set in Property.

I/O LED Monitor Screen

LED monitor of the selected controller is displayed by pressing the I/O Monitor button. It supports safety I/O units (NX-SI series, NX-SO series), but not regular NX-I/O unit.

The LED status is updated every 1 second.

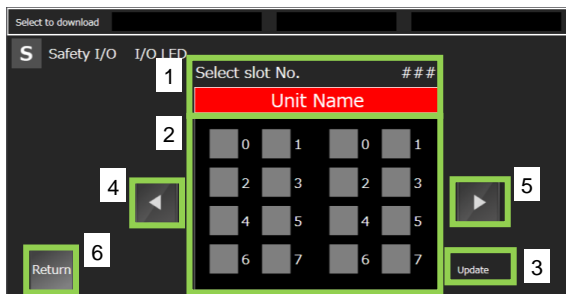


User I/F Specification

No	Part	Description
1	Data Display	The selected slot number and unit model are shown.
2	Data Display	Status of safety I/O unit LED is indicated.
3	Label	The reading blinks during an update of LED status.
4	Button	The button shows the LED status of the left unit.
5	Button	The button shows the LED status of the right unit.
6	Button	This button enables to switch to the Main Screen.

Layout

Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

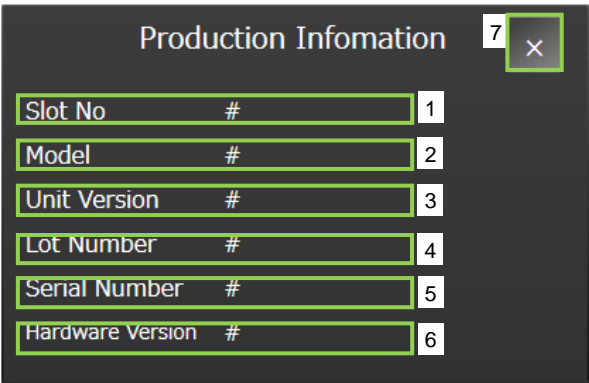Production Information Screen	Product information about the selected unit is shown in this screen by pressing the Production Information button.
	

User I/F Specification		
No	Part	Description
1	Data Display	Slot number is displayed.
2	Data Display	Model of the unit is displayed.
3	Data Display	Unit version is shown.
4	Data Display	Lot number is shown.
5	Data Display	Serial number is displayed.
6	Data Display	Version number of hardware is displayed.
7	Button	Closes this screen.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

● Properties

Property	Description	Input Mode	Input Range/ Data Type	Default
General				
Name	Object name. Must not be overlapped in a screen.	Direct input	Character string (1 to 127)	IOMonitor0
Type	Object type. Not changeable.	-	-	SafetyCPU_IAG_7inch.IOMonitor
Version	IAG version	-	-	1.5.0.0
Publisher	IAG publisher	-	-	Omron Promotion Sample
Appearance				
Background Color	Background color of a page	Item selection Direct input	Color pallet Character string	Transparent ¹
Layout				
▼Position (Left , Top)	Position setting of object on a page. ²	Direct input Spin button	Numeric Numeric	-
Left	Horizontal position (X-axis) of the top-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
Top	Vertical position (Y-axis) of the to-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
▼Size (Width, Height)	Object size setting.	Direct input Spin button	Numeric Numeric	(760,390)
Width	Width of object	Direct input Spin button	Numeric Numeric	760
Height	Height of object.	Direct input Spin button	Numeric Numeric	390
Input				
FinishReadController	Completion flag for configuration reading	Variable specification	Boolean	(Blank)
Input/Output				
ControllerName	Controller name of connected unit	Variable specification	String(15)	(Blank)
CheckController	Check flag for unit connected with the safety CPU unit.	Variable specification	Boolean(15)	(Blank)
SafetyCPUPosition	Place to where the safety CPU unit is connected.	Variable specification	String(15)	(Blank)
SelectUnitNo	The number of selected unit.	Variable specification	Short	(Blank)

Image

▼ General	
Name	IOMonitor0
Type	SafetyCPU_IAG_7inch.IOMonitor
Version	1.5.0.0
Publisher	Omron Promotion Sample
▼ Appearance	
BackgroundColor	<input type="checkbox"/> Transparent
▼ Layout	
▼ Position (Left,Top)	
Left	0
Top	0
▼ Size (Width,Height)	
Width	760
Height	390
▼ Behavior (Input)	
FinishReadConfiguration	
▼ Behavior (In/Out)	
ControllerName	
CheckController	
SafetyCPUPosition	
SelectUnitNo	

1: Transparent.


2: The origin of coordinates locates at the top left corner of NA screen.

- Events & Actions

No event & action function available.

- Animations

Basic motions of animation can be defined.

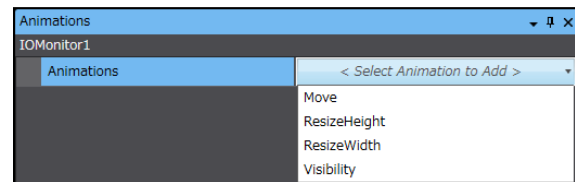

- Security

No security function available.

5-3-2 Installation to Screen


● Property Assignment

This IAG uses the safety configuration information which has been read out by ReadConfiguration.

Be sure to place ReadConfiguration IAG in the first displayed screen. Assign variables to the following properties (input/output) to share the safety configuration information.

Property (Input)	Description	Data Type
FinishReadConfiguration	Completion flag for configuration reading	Boolean

Property (Input/Output)	Description	Data Type
ControllerName	Controller name of connected unit	String(15)
CheckController	Check flag for unit connected with the safety CPU unit.	Boolean(15)
SafetyCPUPosition	Place to where the safety CPU unit is connected.	String(15)
SelectUnitNo	The number of selected unit.	Short

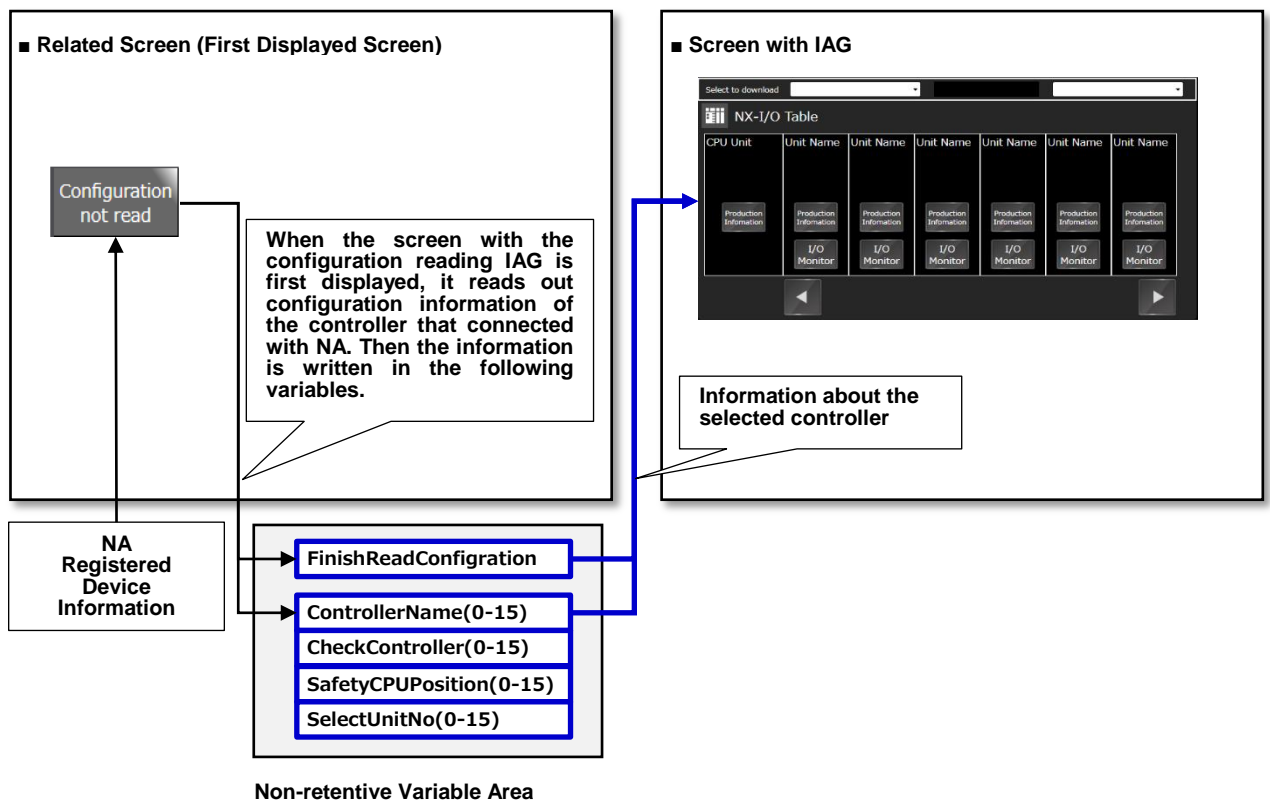

5-4 RestoreFileDownload

5-4-1 Specifications

- External Specification

Object Name	RestoreFileDownload
Category	Safety CPU
Description	With this IAG, you can transfer restored files in NA USB memory to controllers in order to restore the safety CPU unit. Login to NA before downloading restored files.
Function	Downloads restored files of the safety CPU unit to controllers. [Download] Executes downloading of restored files, and displays procedure to restore.
Graphics	<p>This IAG consists of eight screens and three pop-ups. Details are described in page 34, "Screen Specifications".</p> <ul style="list-style-type: none"> ■ Error Window (No restored file) ■ Error Window (Unsupported unit) ■ Main Screen ■ File Download Screen ■ Download Completion Screen ■ Error Window (Failed download) ■ Restore Mode Start Screen ■ Standby for Start Screen ■ Standby for Completion Screen ■ Restoring Completion Screen ■ Restart Screen <pre> graph TD subgraph ErrorWindows E1[Error Window (No restored file)] E2[Error Window (Unsupported unit)] end subgraph MainScreen MS[Main Screen] end subgraph FileDownloadScreen FDS[File Download Screen] end subgraph DownloadCompletionScreen DCS[Download Completion Screen] end subgraph ErrorFailedDownload EFD[Error Window (Failed download)] end subgraph RestoreModeStartScreen RMS[Restore Mode Start Screen] end subgraph StandbyStartScreen SSS[Standby for Start Screen] end subgraph StandbyCompletionScreen SSC[Standby for Completion Screen] end subgraph RestoringCompletionScreen RCS[Restoring Completion Screen] end subgraph RestartScreen RS[Restart Screen] end E1 --> MS E2 --> MS MS --> FDS FDS -- Execute --> DCS DCS -- Error --> EFD DCS -- Next --> RMS RMS -- Next --> SSS SSS -- Back --> MS SSS -- Next --> SSC SSC -- Back --> MS SSC -- Next --> RCS RCS -- Back --> MS RCS -- Next --> RS RS -- Back --> MS </pre>


● Screen Specifications

Main Screen	Pressing the download button, you can go to procedures to download restored files and to implement restoring.


User I/F Specification		
No	Part	Description
1	DropDown	You can select a controller from the drop-down list. Restored files are downloaded to the selected controller.
2	Data Display	Model of the connected safety CPU unit is shown.
3	Button	Download is executed by pressing this button.
Layout		
Property	Default	Description
Position (Left, Up)		Set in Properties.
Size (Width, Height)		Set in Properties.

File Download Screen	Restored file download confirmation dialog is displayed by pressing the Download button on Main Screen. Pressing the Execute button, you can download the restored files, which stored in NA USB memory, to an SD card of the controller.


User I/F Specification		
No	Part	Description
1	Button	Executes download of restored files.
2	Button	Cancel the download. The screen is switched to Main Screen.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

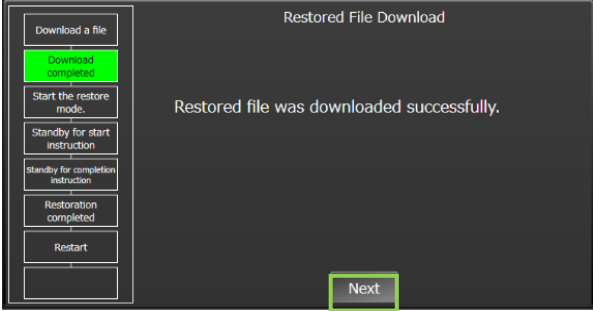Download Completion Screen	After the Execute button was pressed, this screen appears if the download has been successfully completed.
	


User I/F Specification		
No	Part	Description
1	Button	Enables to go to the Restore Mode Start Screen.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

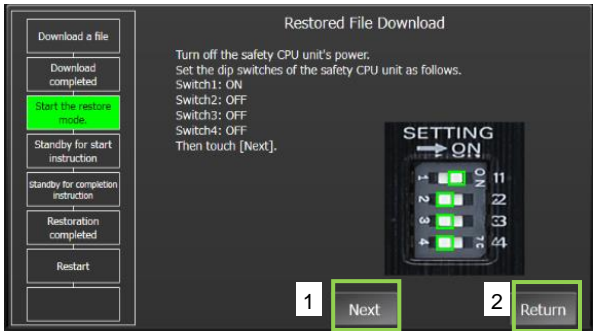Restore Mode Start Screen	This screen is displayed after the Next button is pressed on Download Completion Screen. It shows the procedure to start restoring mode.
	


User I/F Specification		
No	Part	Description
1	Button	Enables to jump to Standby for Start Instruction Screen.
2	Button	You can go back to Main Screen.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

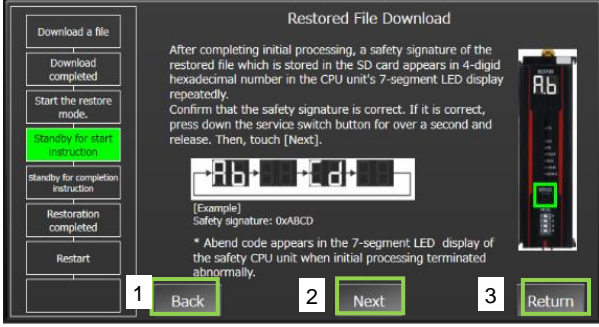Standby for Start Instruction Screen	<p>This screen is displayed when the Next button is pressed on Restoring Start Screen. It shows the restoring procedure such as checking safety signature.</p> 
--------------------------------------	---


User I/F Specification		
No	Part	Description
1	Button	Enables to go to Restore Mode Start Screen.
2	Button	Enables to go to Standby for Completion Instruction Screen.
3	Button	You can go back to Main Screen.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

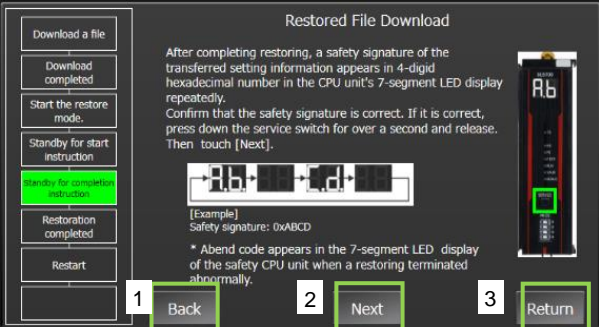Standby for Completion Instruction Screen	<p>This screen appears when the Next button is pressed on Standby for Start Instruction Screen. It shows the restoring procedure such as checking safety signature.</p> 
---	--


User I/F Specification		
No	Part	Description
1	Button	Enables to back to Standby for Start Instruction Screen.
2	Button	Enables to go to Restoring Completion Screen.
3	Button	You can go back to Main Screen.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

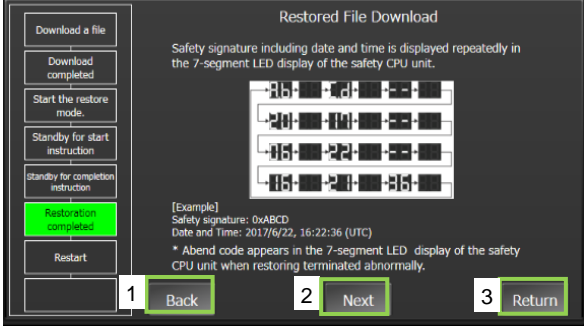Restoring Completion Screen	<p>This screen appears when the Next button is pressed on Standby for Completion Instruction Screen. It describes the procedure for normal/abnormal end of restoring.</p>
	


User I/F Specification		
No	Part	Description
1	Button	Enables to back to Restoring Completion Screen.
2	Button	Enables to go to Restart Screen.
3	Button	You can go back to Main Screen.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

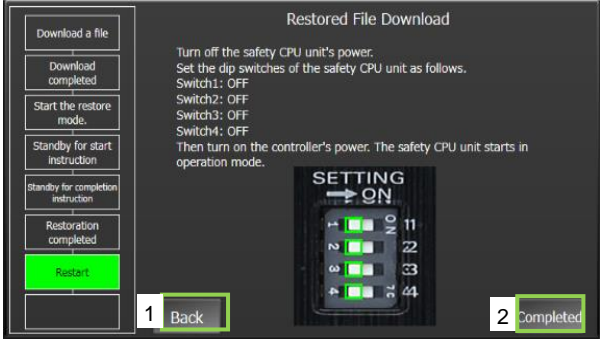Restart Screen	<p>This screen is displayed when the Next button is pressed on Restoring Completion Screen. It describes the procedure to restart.</p>
	


User I/F Specification		
No	Part	Description
1	Button	Enables to back to Restoring Completion Screen.
2	Button	You can go back to Main Screen.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

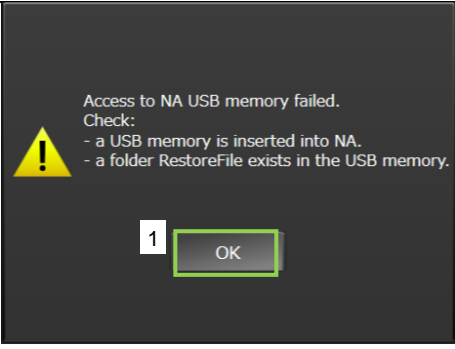Error Window (No restored file)	This pop-up appears when restored files do not exist in a USB memory or NA has failed to access a USB memory.
	

User I/F Specification		
No	Part	Description
1	Button	Closes this window.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

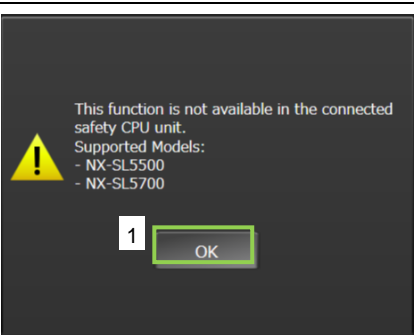Error Window (Unsupported unit)	This pop-up appears if the connected unit is not supported by the safety CPU.
	

User I/F Specification		
No	Part	Description
1	Button	Closes this window.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

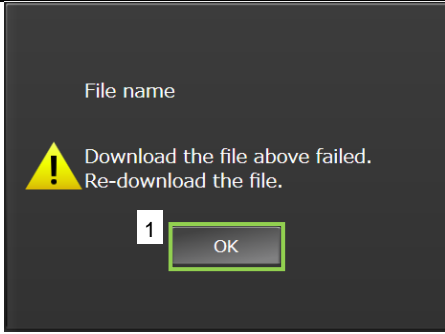Error Window (Failed download)	This pop-up is displayed if the download of restored files has been failed.	
		

User I/F Specification		
No	Part	Description
1	Button	Closes this window.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

● Properties

Property	Description	Input Mode	Input Range/ Data Type	Default
General				
Name	Object name. Must not be overlapped in a screen.	Direct input	Character string (1 to 127)	RestoreFileDownLoad0
Type	Object type. Not changeable.	-	-	SafetyCPU_IAG_7inch.RestoreFileDownLoad
Version	IAG version	-	-	1.2.0.0
Publisher	IAG publisher	-	-	Omron Promotion Sample
Appearance				
Background Color	Background color of a page	Item selection Direct input	Color pallet Character string	Transparent ¹
Layout				
▼Position (Left , Top)	Position setting of object on a page. ²	Direct input Spin button	Numeric Numeric	-
Left	Horizontal position (X-axis) of the top-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
Top	Vertical position (Y-axis) of the to-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
▼Size (Width, Height)	Object size setting.	Direct input Spin button	Numeric Numeric	(760,390)
Width	Width of object	Direct input Spin button	Numeric Numeric	760
Height	Height of object.	Direct input Spin button	Numeric Numeric	390
Input				
FinishReadConfiguration	Completion flag for configuration reading	Variable specification	Boolean	(Blank)
Input/Output				
ControllerName	Controller name of connected unit	Variable specification	String(15)	(Blank)
CheckController	Check flag for unit connected with the safety CPU unit.	Variable specification	Boolean(15)	(Blank)
SafetyCPUPosition	Place to where the safety CPU unit is connected.	Variable specification	String(15)	(Blank)
SelectUnitNo	The number of selected unit.	Variable specification	Short	(Blank)

Image

▼ General	
Name	RestoreFileDownLoad0
Type	SafetyCPU_IAG_7inch.RestoreFileDownLoad
Version	1.2.0.0
Publisher	Omron Promotion Sample
▼ Appearance	
BackgroundColor	<input type="checkbox"/> Transparent
▼ Layout	
▼ Position (Left,Top)	
Left	0
Top	0
▼ Size (Width,Height)	
Width	760
Height	390
▼ Behavior (Input)	
FinishReadConfiguration	
▼ Behavior (In/Out)	
ControllerName	
CheckController	
SafetyCPUPosition	
SelectUnitNo	

1: Transparent.


2: The origin of coordinates locates at the top left corner of NA screen.

- Events & Actions

No event & action function available.

- No event & action functions available.

Basic motions of animation can be defined.

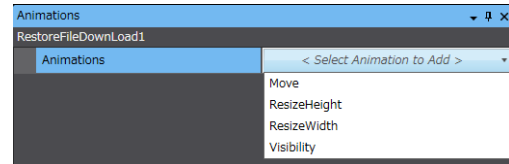

- Security

No security function available.

5-4-2 Installation to Screen


● 5-4-2 Installation to Screen

This IAG uses the safety configuration information which has been read out by ReadConfiguration.

Be sure to place ReadConfiguration IAG in the first displayed screen. Assign variables to the following properties (input/output) to share the safety configuration information.


Property (Input)	Description	Data Type
FinishReadConfiguration	Completion flag for configuration reading	Boolean


Property (Input/Output)	Description	Data Type
ControllerName	Controller name of connected unit	String(15)
CheckController	Check flag for unit connected with the safety CPU unit.	Boolean(15)
SafetyCPUPosition	Place to where the safety CPU unit is connected.	String(15)
SelectUnitNo	The selected unit number.	Short

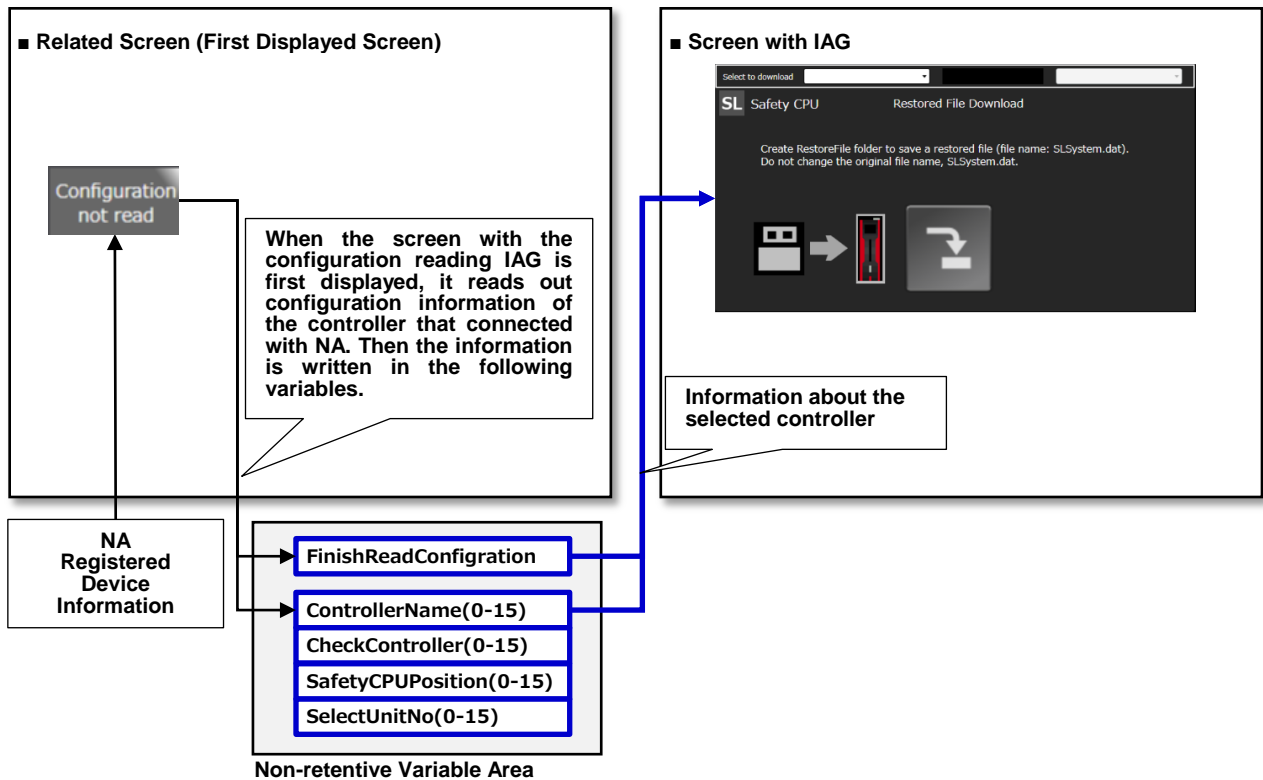


- Screen Transition

The figure below is a screen transition diagram of IAG objects use.

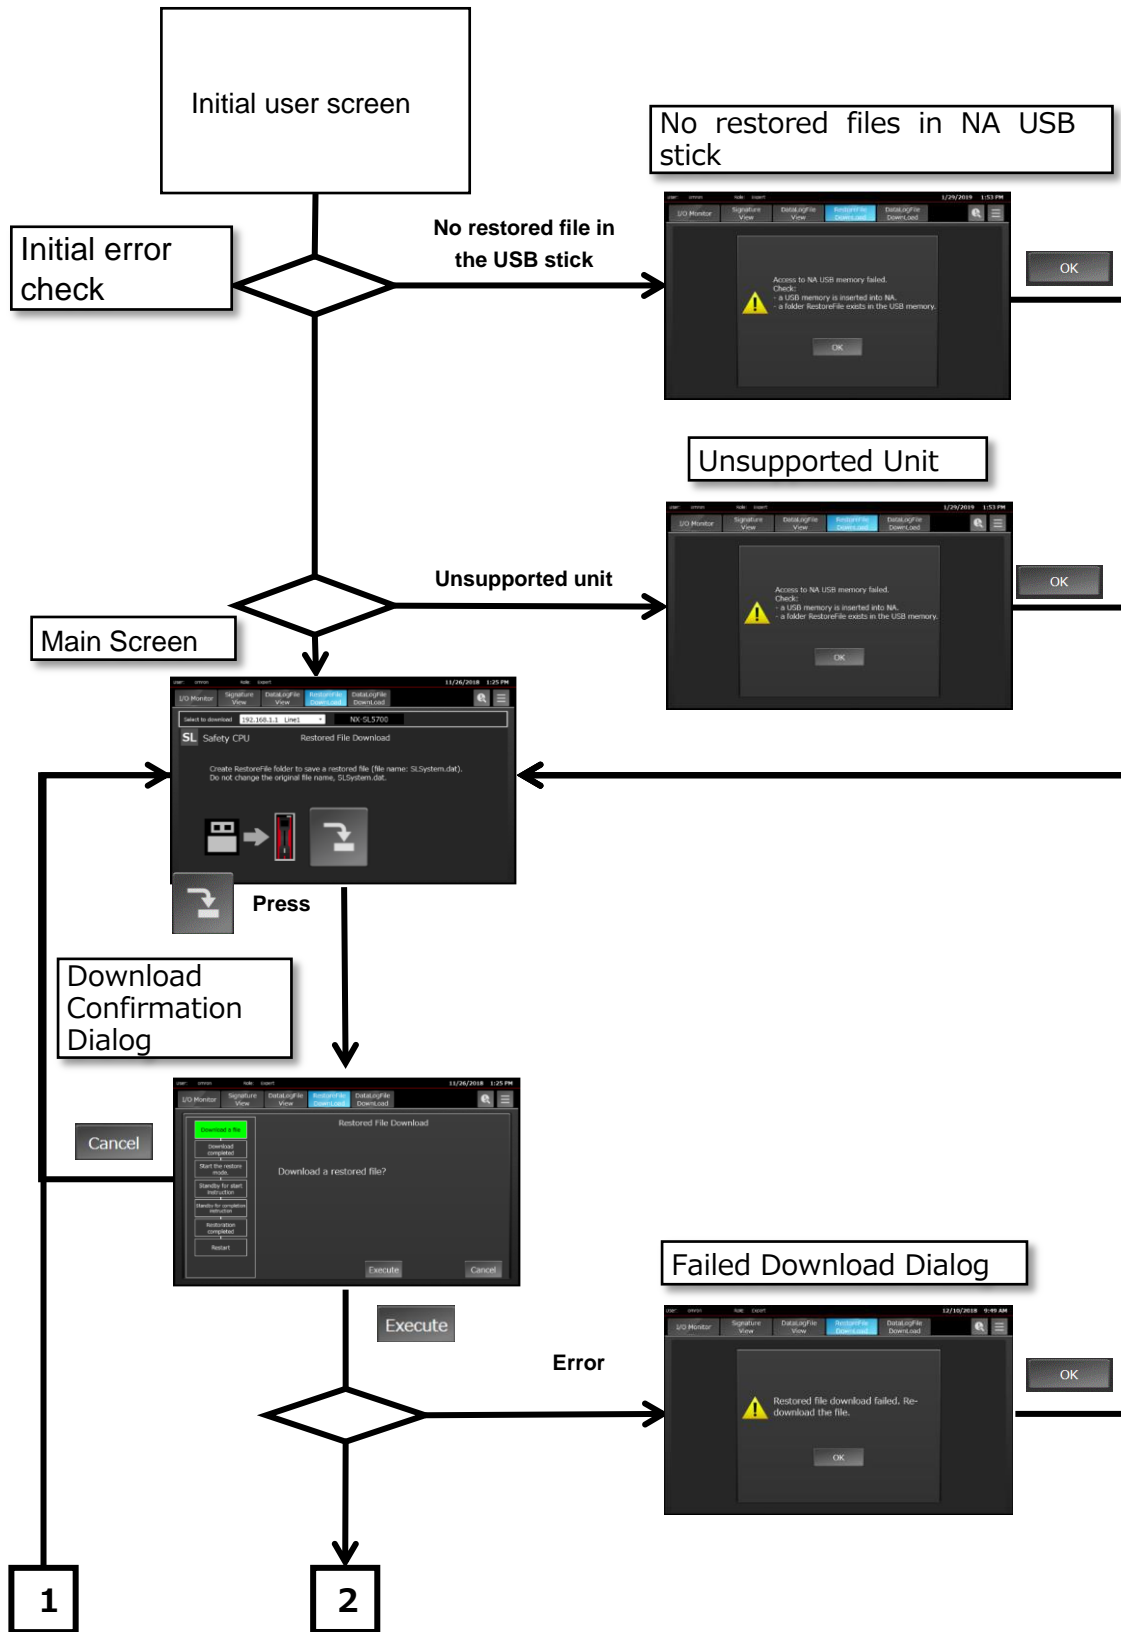

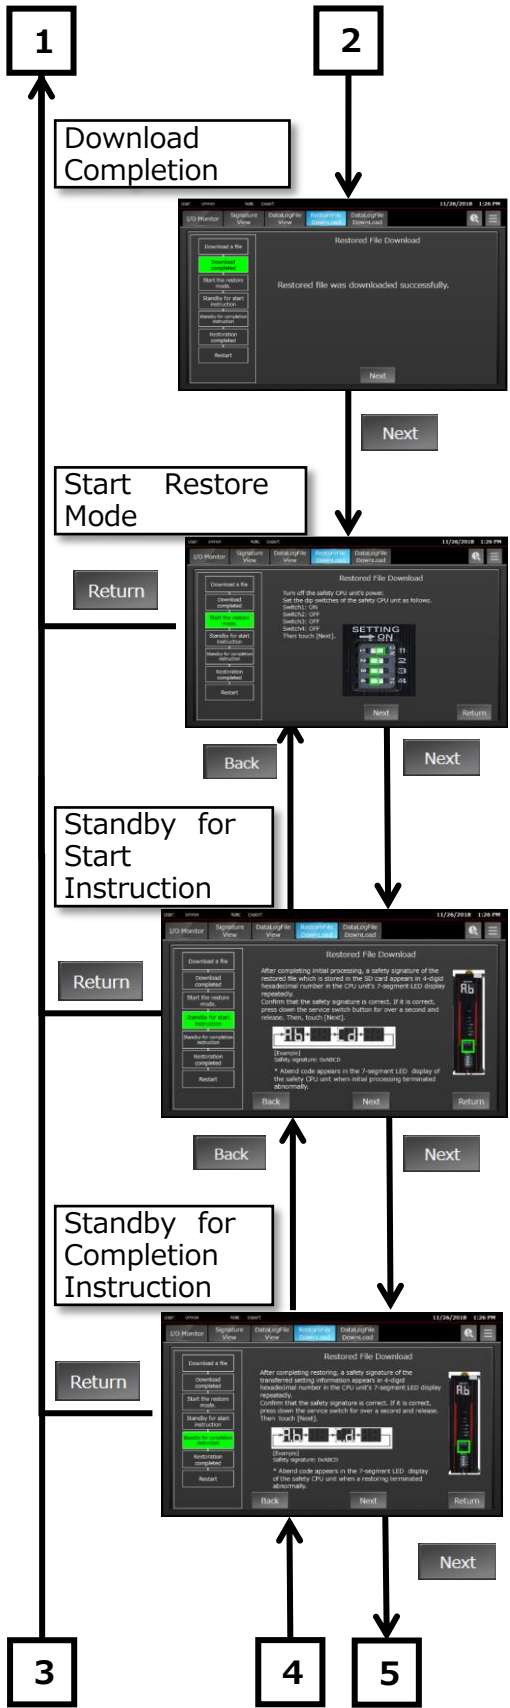

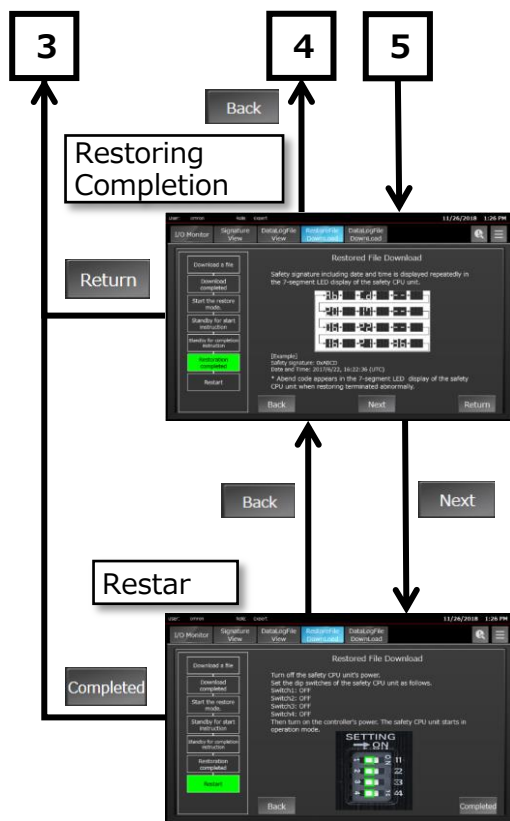

Customers will have to design screens if there is any necessary object except IAG objects.

5-5 DataLogFileDownload

5-5-1 Specifications

● External Specification

Object Name	DataLogFileDownload
Category	Safety CPU
Description	Transfers data log setting files in NA USB memory to controllers to execute data logging of the safety CPU unit.
Function	It enables to download data logging settings of the safety CPU unit to controllers. [Update] Updates file lists of data log No.1 and No.2. [Download] Downloads data log setting file No.1 or No.2, and shows the data logging procedure.
Graphic	<p>This IAG consists of five screens and 5 pop-ups.</p> <p>Initial error check</p> <ul style="list-style-type: none"> ■ Error Window (No data log setting folder) ■ Error Window (Unsupported unit) <pre> graph TD subgraph InitialErrorCheck E1[Error Window: No data log setting folder] E2[Error Window: Unsupported unit] end subgraph MainScreen MS[Main Screen] end subgraph DownloadScreen DS[Download Screen] end subgraph DownloadCompletionScreen DCS[Download Completion Screen] end subgraph DataLoggingValidatingScreen DLS[Data logging Validating Screen] end subgraph DataLoggingSettingsUpdateScreen DLSU[Data Logging Settings Update Screen] end E1 --> MS E2 --> MS MS --> DS DS -- Execute --> DCS DCS -- Next --> DLS DLS -- Next --> DLSU DLSU -- Back --> DLS MS -- Error --> E3[Error Window: Lack of setting check file] MS -- Error --> E4[Error Window: Lack of data log setting file] MS -- Error --> E5[Error Window: Failed download] DS -- Error --> E3 DS -- Error --> E4 DS -- Error --> E5 </pre> <ul style="list-style-type: none"> ■ Error Window (Lack of setting check file) ■ Error Window (Lack of data log setting file) ■ Error Window (Failed download) ■ Download Screen ■ Download Completion Screen ■ Data logging Validating Screen ■ Data Logging Settings Update Screen

● Screen Specification

Main Screen	You can download data log setting files and check the data logging execution procedure by pressing the Download button.

User I/F Specification		
No	Part	Description
1	DropDown Button	You can select the controller where data log setting files are to be downloaded, using the drop-down list.
2	Data Display	Displays the model of connected safety CPU unit.
3	Button	Updates file lists displayed in [4] and [5].
4	ListBox	A list of data logging files (logging setting No.1) is shown here. You can select one to download.
5	ListBox	A list of data logging files (logging setting No.2) is shown here. You can select one to download.
6	Button	Downloads the data logging file that selected in [4].
7	Button	Downloads the data logging file that selected in [5].
Layout		
Property	Default	Description
Position (Left, Up)		Set in Properties.
Size (Width, Height)		Set in Properties.

Download Screen	<p>Confirmation dialog for data log setting file download is displayed. This screen appears when you pressed the Download button on Main Screen.</p> <p>After the Execute button pressed, data log setting files that stored in NA USB memory are downloaded to SD card in the controller.</p>

User I/F Specification		
No	Part	Description
1	Button	Executes download of data log setting files.
2	Button	Download can be cancelled with this Cancel button. After pressing it, you can 戻 go back to Main Screen.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

Download Completion Screen	<p>This screen appears if a download is successfully completed after you press the Execute button on Download Screen.</p>


User I/F Specification		
No	Part	Description
1	Button	Enables to jump to Data Logging Validation Screen.
2	Button	You can go back to Main Screen.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

Data Logging Validation Screen	<p>This screen is displayed by pressing the Next button on Download Completion Screen. It suggests the procedure to validate data logging.</p>


User I/F Specification		
No	Part	Description
1	Button	Not displayed in the NA.
2	Button	Enables to jump to Data Logging Settings Update Screen.
3	Button	You can go back to Main Screen.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

Data Logging Settings Update Screen	<p>This screen is shown when the Next button is pressed on Data Logging Validation Screen. The update procedure for data logging settings is displayed.</p>


User I/F Specification		
No	Part	Description
1	Button	Enables to jump to Data Logging Validation Screen.
2	Button	You can go back to Main Screen.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

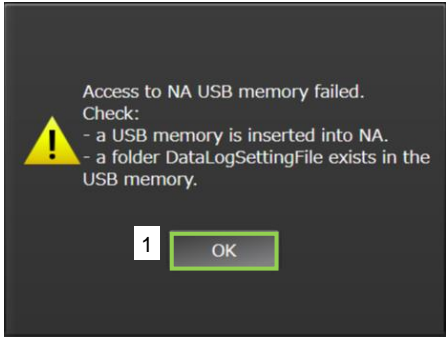Error Window (No data log setting folder)	This pop-up appears when there is no designated folder in a USB memory or access to the USB memory is denied.
	


User I/F Specification		
No	Part	Description
1	Button	Closes the window.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

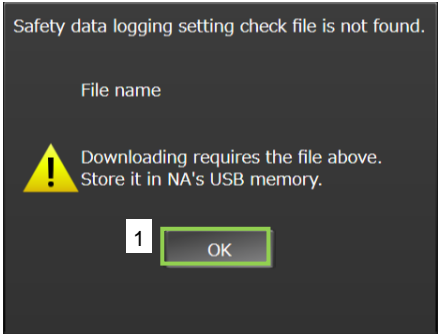Error Window (Lack of setting check file)	This pop-up is displayed if the file to check data logging settings is lacking.
	


User I/F Specification		
No	Part	Description
1	Button	Closes the window.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

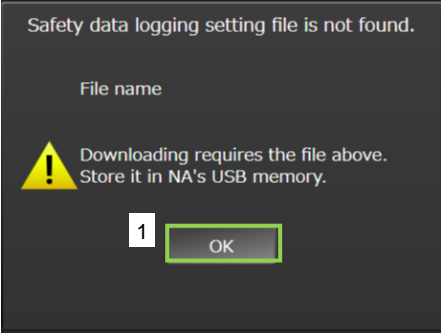Error Window (Lack of data log setting file)	This pop-up is shown if data logging file is missing.
	

User I/F Specification		
No	Part	Description
1	Button	Closes the window.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

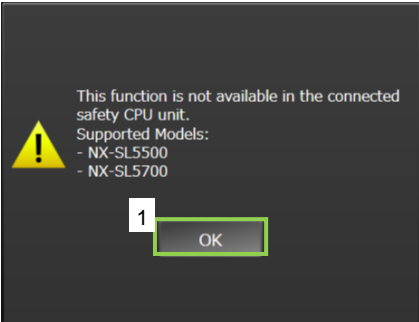Error Window (Unsupported unit)	This pop-up appears when the connected safety CPU unit is not supported.
	

User I/F Specification		
No	Part	Description
1	Button	Closes the window.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

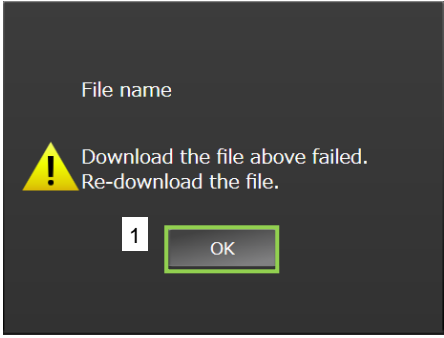Error Window (Failed download)	<p>This pop-up is displayed when a data logging setting file has not been downloaded properly.</p> 
-----------------------------------	---

User I/F Specification		
No	Part	Description
1	Button	Closes the window.
Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

● Properties

Property	Description	Input Mode	Input Range/ Data Type	Default
General				
Name	Object name. Must not be overlapped in a screen.	Direct input	Character string (1 to 127)	DataLogFileDownload0
Type	Object type. Not changeable.	-	-	SafetyCPU_IAG_7inch.DataLogFileDownload
Version	IAG version	-	-	1.4.0.0
Publisher	IAG publisher	-	-	Omron Promotion Sample
Appearance				
Background Color	Background color of a page	Item selection Direct input	Color pallet Character string	Transparent ¹
Layout				
▼Position (Left , Top)	Position setting of object on a page. ²	Direct input Spin button	Numeric Numeric	-
Left	Horizontal position (X-axis) of the top-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
Top	Vertical position (Y-axis) of the to-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
▼Size (Width, Height)	Object size setting.	Direct input Spin button	Numeric Numeric	(760,390)
Width	Width of object	Direct input Spin button	Numeric Numeric	760
Height	Height of object.	Direct input Spin button	Numeric Numeric	390
Input				
FinishReadConfiguration	Completion flag for configuration reading	Variable specification	Boolean	(Blank)
Input/Output				
ControllerName	Controller name of connected unit	Variable specification	String(15)	(Blank)
CheckController	Check flag for unit connected with the safety CPU unit.	Variable specification	Boolean(15)	(Blank)
SafetyCPUPosition	Place to where the safety CPU unit is connected.	Variable specification	String(15)	(Blank)
SelectUnitNo	The unit number of selected unit.	Variable specification	Short	(Blank)

Image

▼ General	
Name	DataLogFileDownload0
Type	SafetyCPU_IAG_7inch.DataLogFileDownload
Version	1.4.0.0
Publisher	Omron Promotion Sample
▼ Appearance	
BackgroundColor	<input type="checkbox"/> Transparent
▼ Layout	
▼ Position (Left,Top)	0, 0
Left	0
Top	0
▼ Size (Width,Height)	760, 390
Width	760
Height	390
▼ Behavior (Input)	
FinishReadConfiguration	
▼ Behavior (In/Out)	
ControllerName	
CheckController	
SafetyCPUPosition	
SelectUnitNo	

1: Transparent.


2: The origin of coordinates locates at the top left corner of NA screen.

- Events & Actions

No event & action function available.

- Animations

Basic motions of animation can be defined.

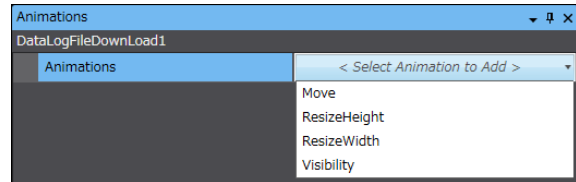

- Security

No security function available.

5-5-2 Installation to Screen


● Property Assignment

This IAG uses the safety configuration information which has been read out by ReadConfiguration.

Be sure to place ReadConfiguration IAG in the first displayed screen. Assign variables to the following properties (input/output) to share the safety configuration information.


Property (Input)	Description	Data Type
FinishReadConfiguration	Completion flag for configuration reading	Boolean


Property (Input)	Description	Data Type
ControllerName	Controller name of connected unit	String(15)
CheckController	Check flag for unit connected with the safety CPU unit.	Boolean(15)
SafetyCPUPosition	Place to where the safety CPU unit is connected.	String(15)
SelectUnitNo	The selected unit number.	Short

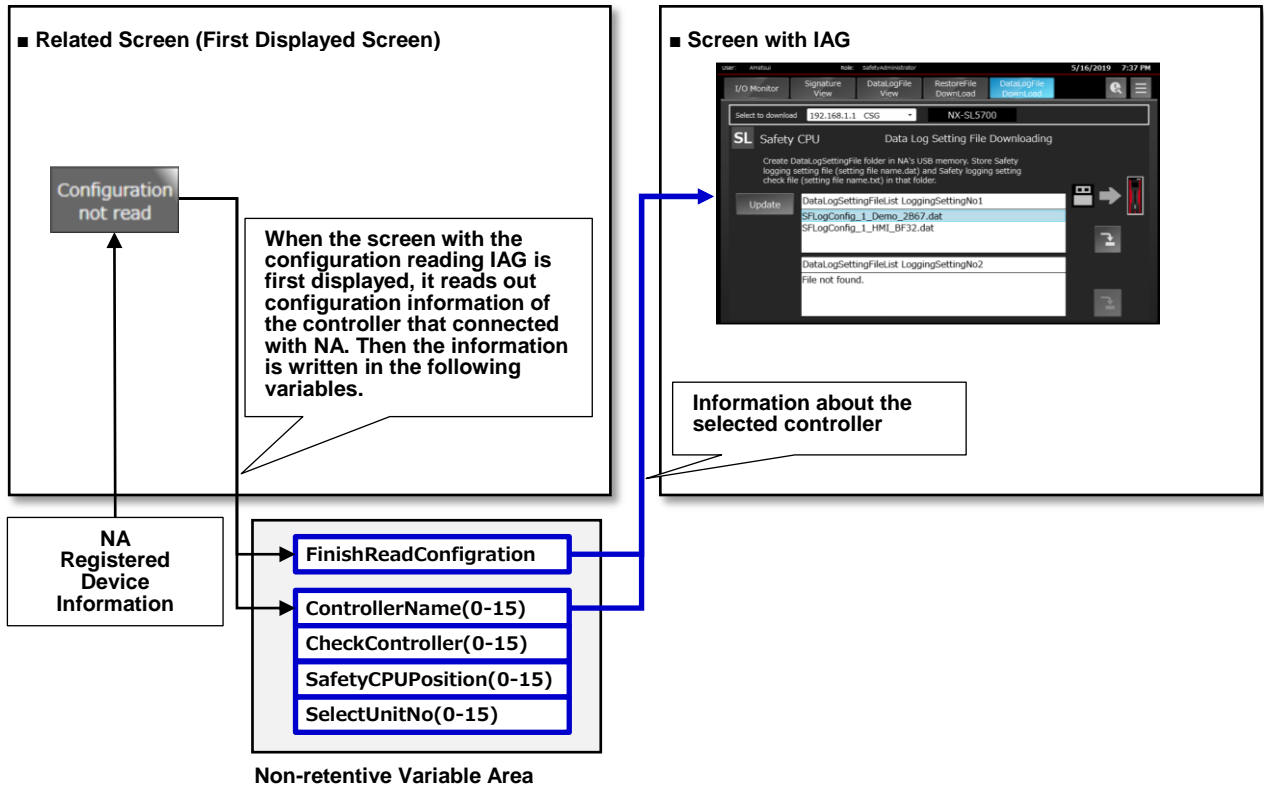

- Screen Transition

The figure below is a screen transition diagram of IAG objects use.

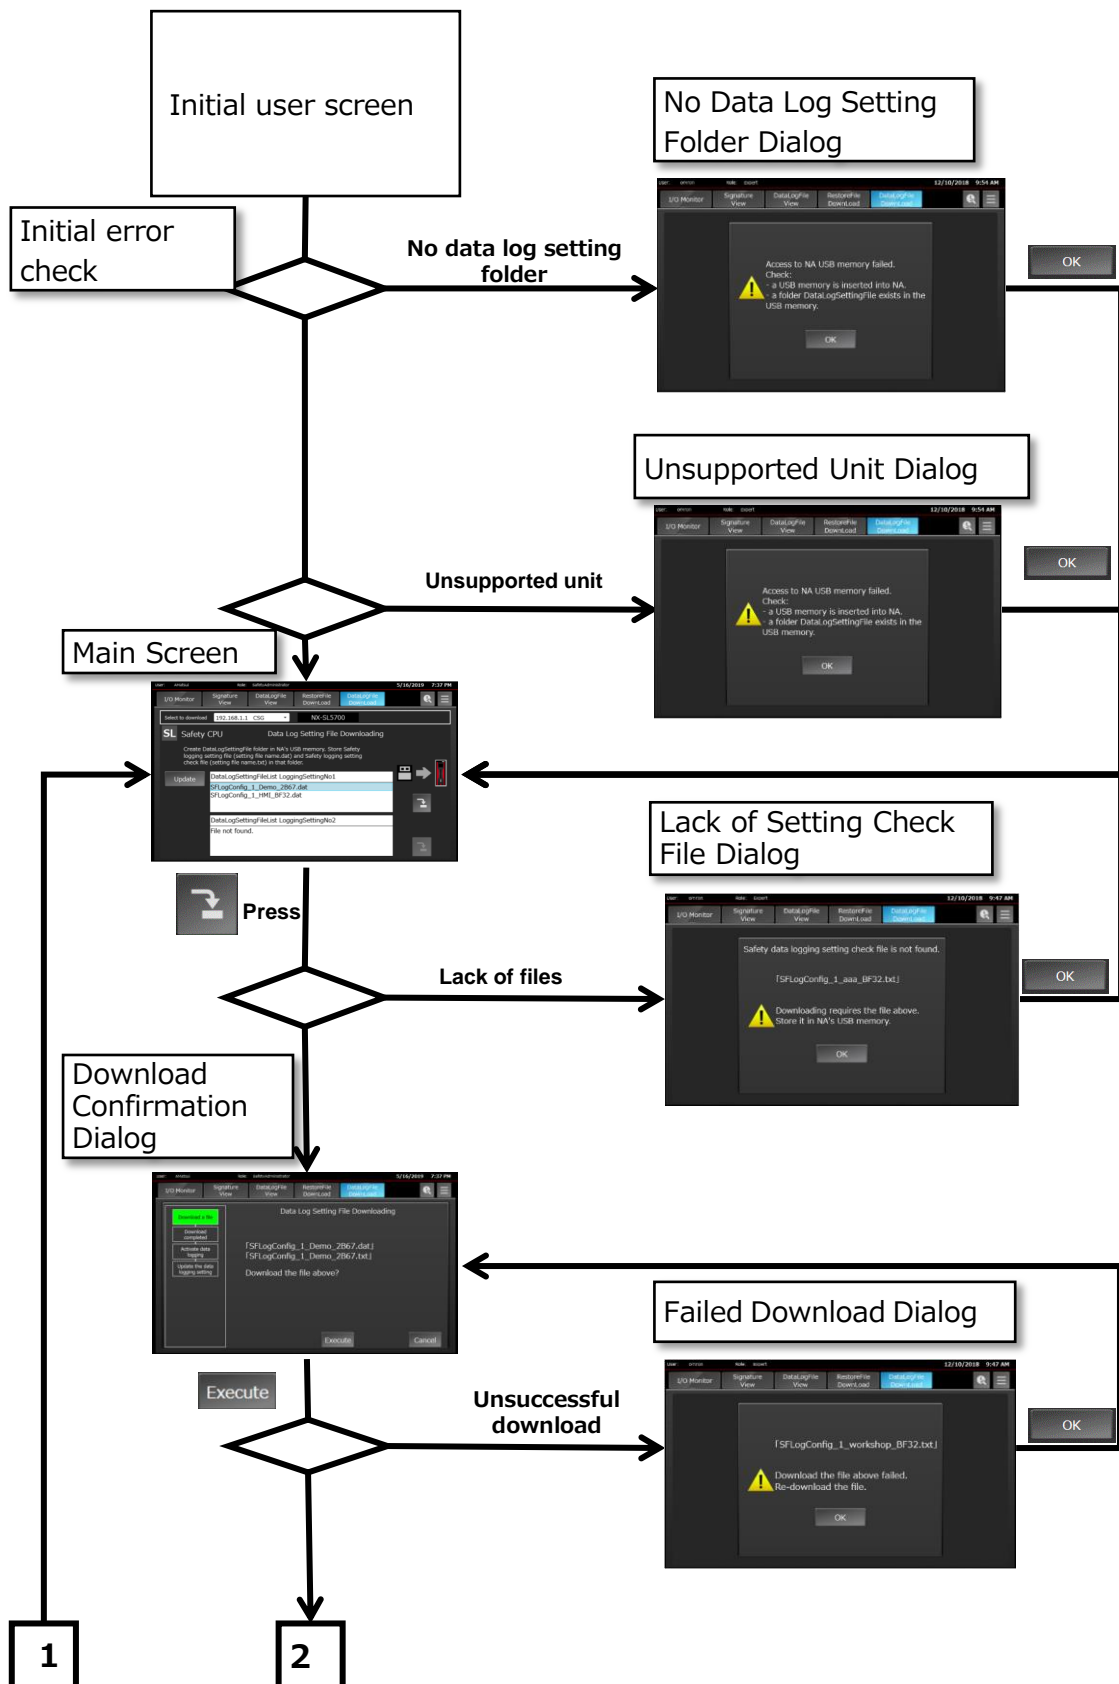


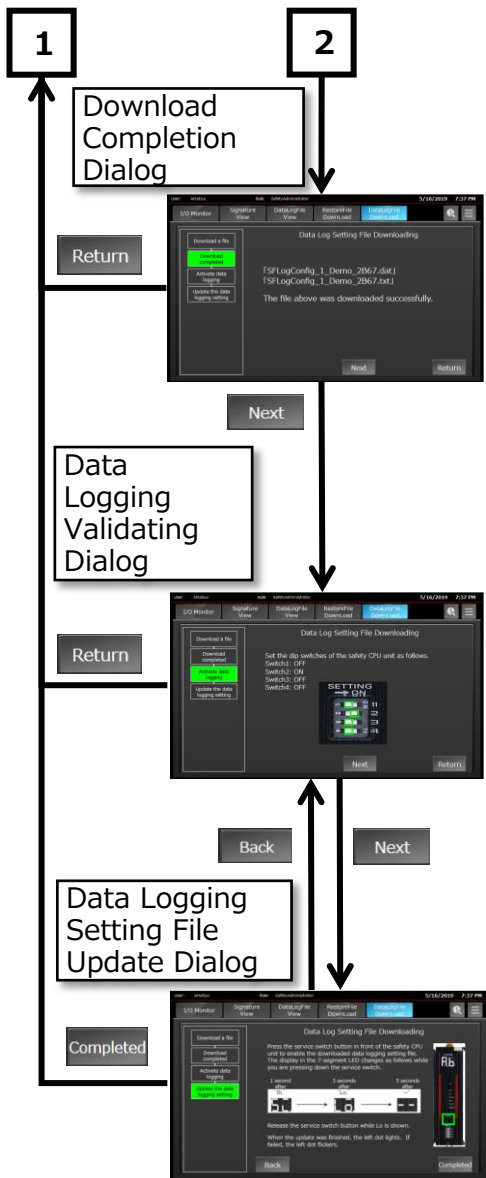


Customers will have to design screens if there is any necessary object except IAG objects.


5-6 DataLogFileView

5-6-1 Specifications

● External Specification

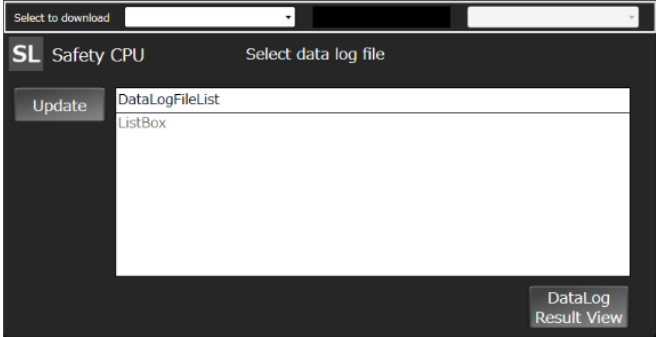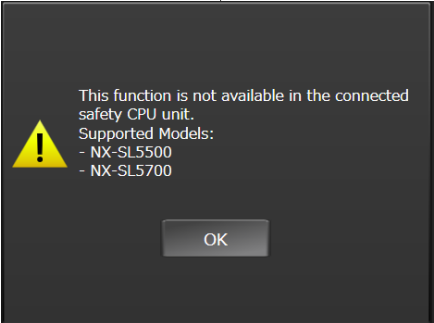
Object Name	DataLogFileView
Category	SafetyCPU_DataLogResultViewer
Description	Use this IAG component in conjunction with the following IAGs: SelectDataLogParameter, GraphDisplay, and DataLogResultMeasurement.
Function	The IAG displays the safety CPU unit data log files. [Update] Updates a list of data log result files. [Data Log Result View] Opens the selected data log result file, then enables to go to SelectDataLogParameter.
Graphic	<p>This IAG contains a screen and a pop-up.</p> <ul style="list-style-type: none">■ Main Screen  <p>Check unsupported unit</p> <ul style="list-style-type: none">■ Error Window (Unsupported unit) 

● Screen Specification

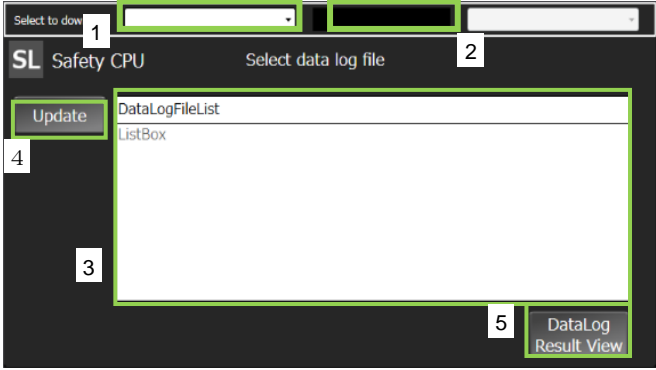Main Screen	<p>A list of data log result files which stored in the safety CPU SD card is displayed on this screen. You can select a file here.</p> 
-------------	---

User I/F Specification		
No	Part	Description
1	DropDown Button	You can select the controller from a drop-down list in order to display its data log files. The file list is displayed in the [3] box.
2	Data Display	Shows the unit model of the connected safety CPU.
3	ListBox	A list of saved data log files in the safety CPU SD card is displayed here. You can select a file from the list.
4	Button	Updates the list in [3].
5	Button	Opens the file selected in [3]. Then you go to SelectDataLogParameter automatically.

Layout		
Property	Default	Description
Position (Left, Up)		Set in Properties.
Size (Width, Height)		Set in Properties.

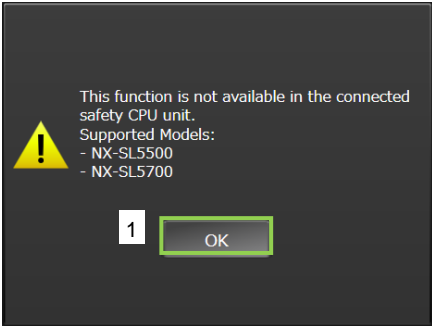Error Window (Unsupported unit)	<p>This pop-up appears when the connected unit is not supported.</p> 
---------------------------------	---

User I/F Specification		
No	Part	Description
1	Button	Closes the window.

Layout		
Property	Default	Description
Position (Left, Up)		Fixed
Size (Width, Height)		Fixed

● Properties

Property	Description	Input Mode	Input Range/ Data Type	Default
General				
Name	Object name. Must not be overlapped in a screen.	Direct input	Character string (1 to 127)	DataLogFileView0
Type	Object type. Not changeable.	-	-	SafetyCPU_IAG_7inch.DataLogFileView
Version	IAG version	-	-	1.4.0.0
Publisher	IAG publisher	-	-	Omron Promotion Sample
Appearance				
Background Color	Background color of a page	Item selection Direct input	Color pallet Character string	Transparent ¹
Layout				
▼Position (Left , Top)	Position setting of object on a page. ²	Direct input Spin button	Numeric Numeric	-
Left	Horizontal position (X-axis) of the top-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
Top	Vertical position (Y-axis) of the to-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
▼Size (Width, Height)	Object size setting.	Direct input Spin button	Numeric Numeric	(760,390)
Width	Width of object	Direct input Spin button	Numeric Numeric	760
Height	Height of object.	Direct input Spin button	Numeric Numeric	390
Input				
FinishReadConfigration	Completion flag for configuration reading	Variable specification	Boolean	(Blank)
Input/Output				
ControllerName	Controller name of connected unit	Variable specification	String(15)	(Blank)
CheckController	Check flag for unit connected with the safety CPU unit. ³	Variable specification	Boolean(15)	(Blank))
SafetyCPUPosition	Place to where the safety CPU unit is connected.	Variable specification	String(15)	(Blank)
SelectUnitNo	The unit number of the selected unit.	Variable specification	Short	(Blank))
DataLogFileFileName	File name of the downloaded file.	Variable specification	String	(Blank)

Image

▼ General	
Name	DataLogFileView0
Type	SafetyCPU_IAG_7inch.DataLogFileView
Version	1.4.0.0
Publisher	Omron Promotion Sample
▼ Appearance	
BackgroundColor	<input type="checkbox"/> Transparent
▼ Layout	
▼ Position (Left,Top)	
Left	0
Top	0
▼ Size (Width,Height)	
Width	760, 390
Height	390
▼ Behavior (Input)	
FinishReadConfigration	
▼ Behavior (In/Out)	
ControllerName	
CheckController	
SafetyCPUPosition	
SelectUnitNo	
DataLogFileFileName	

1: Transparent.


2: The origin of coordinates locates at the top left corner of NA screen.

- Events & Actions

No event & action function available.

- Animations

Basic motions of animation can be defined.

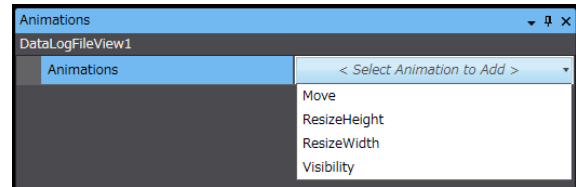

- Security

No security function available.

- **Property Assignment**

This IAG uses the safety configuration information which has been read out by ReadConfiguration.


Be sure to place ReadConfiguration IAG in the first displayed screen. Assign variables to the following properties (input/output) to share the safety configuration information.

Property (Input)	Description	Data Type
FinishReadConfiguration	Completion flag for configuration reading	Boolean

Property (Input)	Description	Data Type
ControllerName	Controller name of connected unit	String(15)
CheckController	Check flag for unit connected with the safety CPU unit.	Boolean(15)
SafetyCPUPosition	Place to where the safety CPU unit is connected.	String(15)
SelectUnitNo	The unit number of the selected unit.	Short


Downloaded data log file names are shared with other IAGs. For that reason, allocate the same variables to the property (input/output) below.

Property (Input)	Description	Data Type
DataLogFileName	File name of the downloaded file.	String

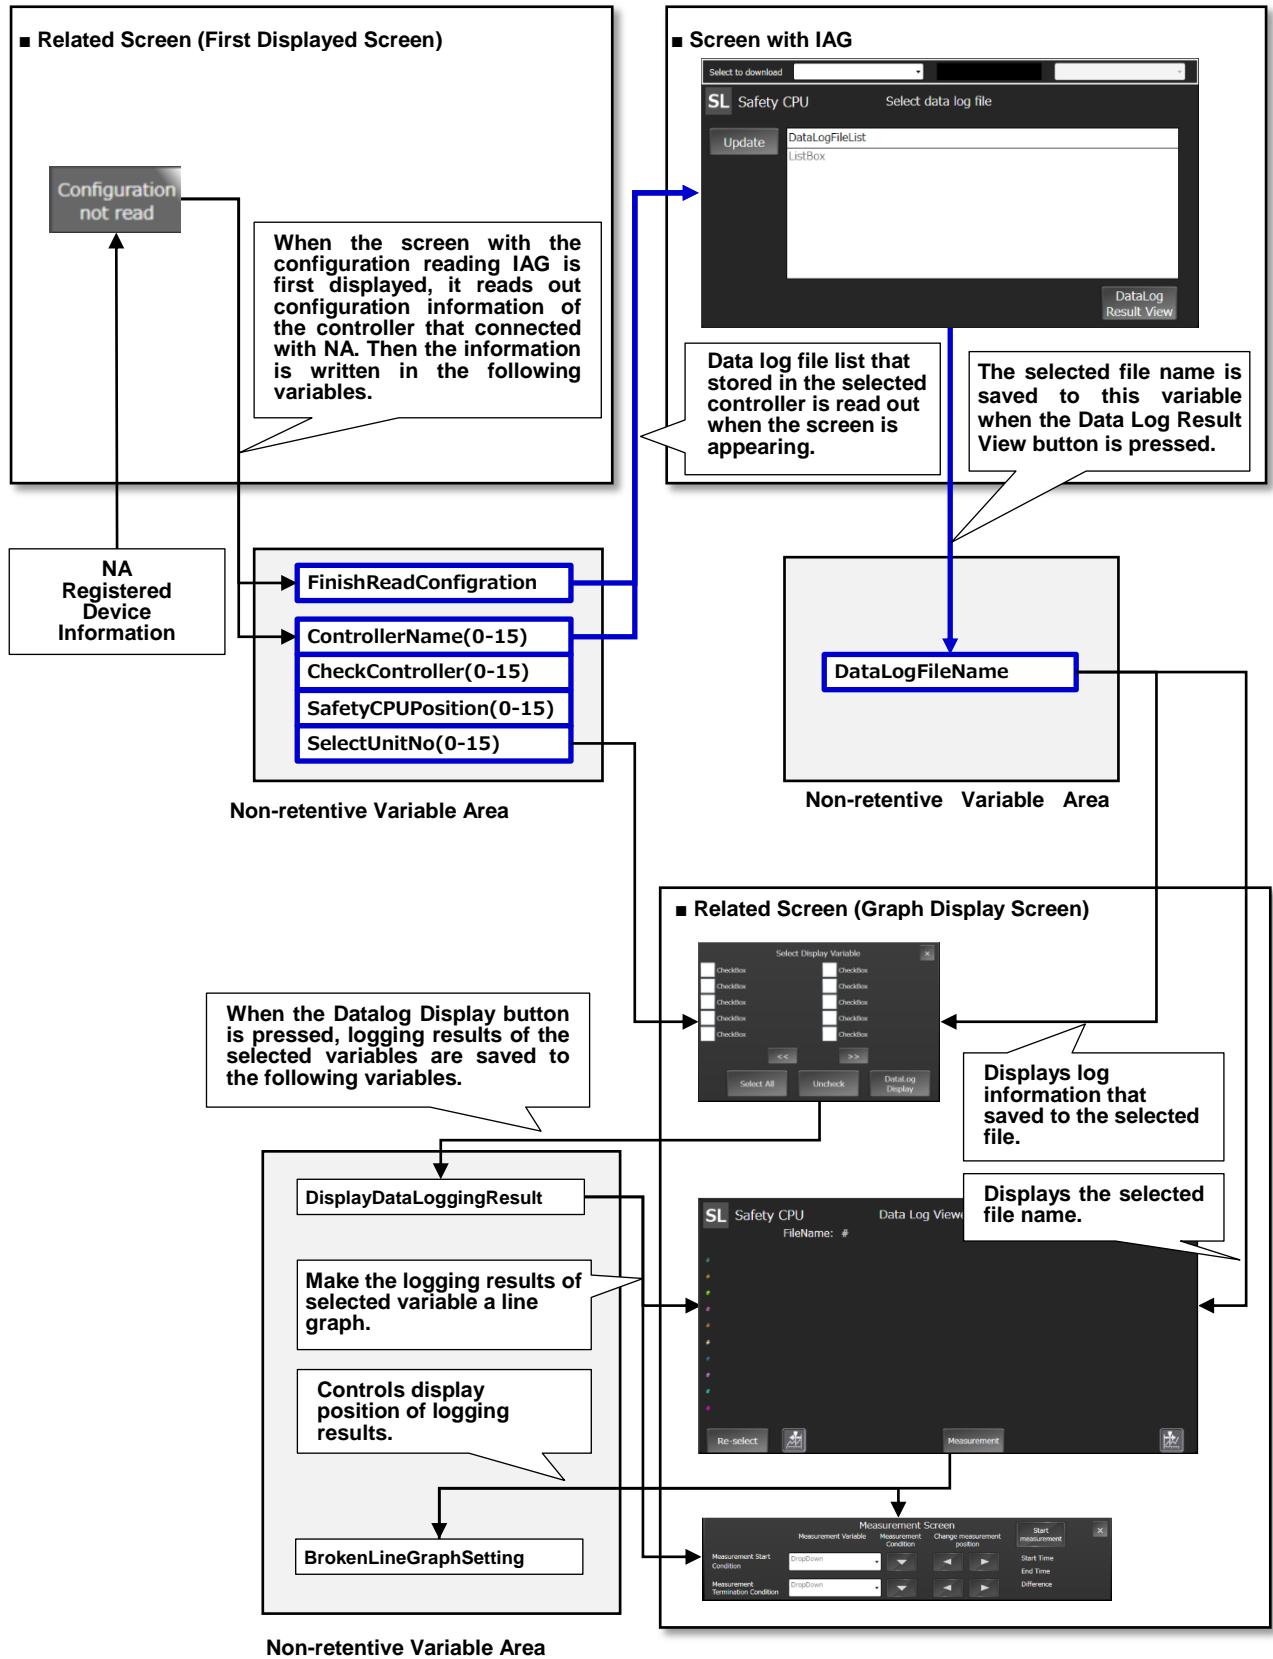

- Screen Transition

The figure below is a screen transition diagram of IAG objects use.

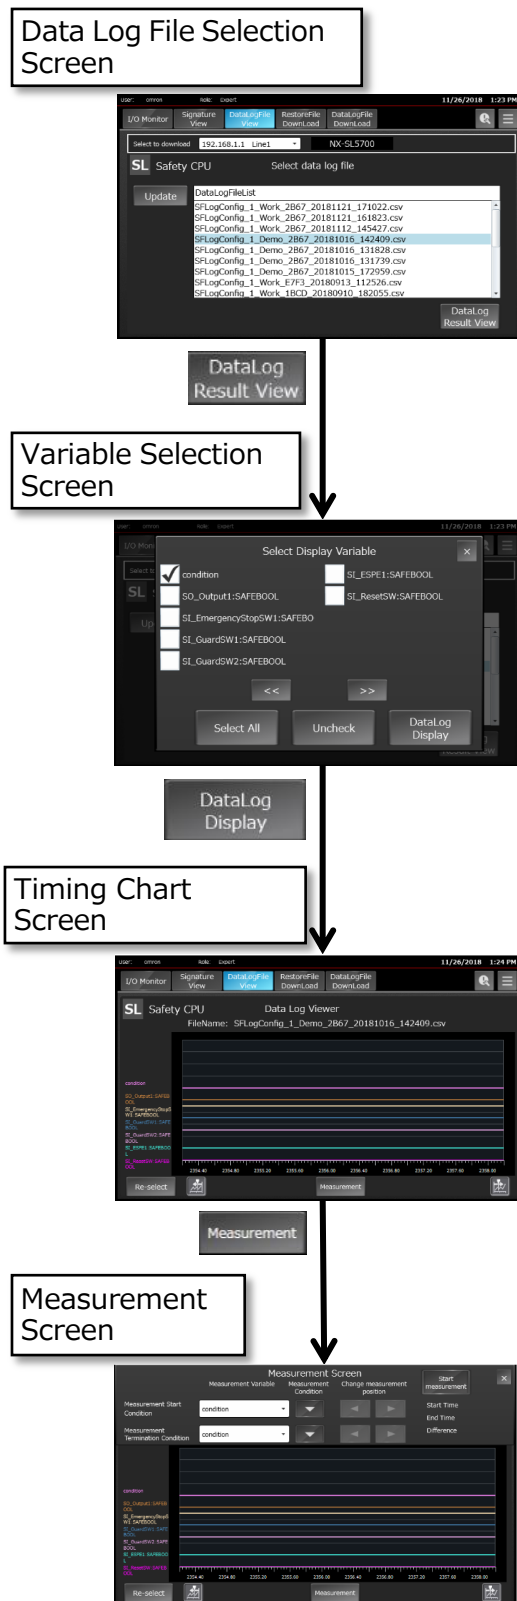


Customers will have to design screens if there is any necessary object except IAG objects.

- Screen Name

Screen names used by data log display IAG objects in the table below are fixed because pages are switched inside IAG. Be sure to use IAG objects in the specified pages.


IAG Object Name	Screen Name
DataLogFileView	DataLogFileView
SelectDataLogParameter	ParameterSelect
GraphDisplay	DataTraceGraphView
DataLogResultMeasurement	MeasurementView

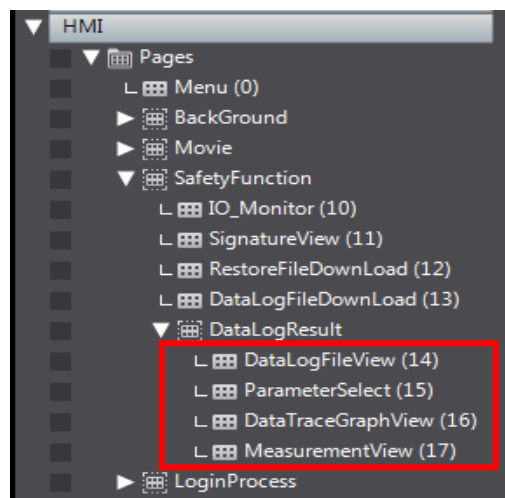

5-7 SelectDataLogParameter

5-7-1 Specifications

● External Specification

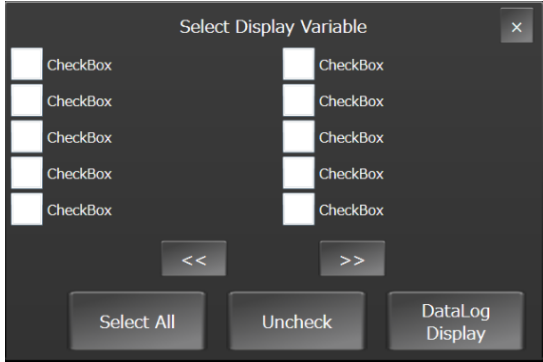Object Name	SelectDataLogParameter
Category	SafetyCPU_DataLogResultViewer
Description	Up to 10 variables can be selected.
Function	<p>This IAG enables to display variables of data log. The selected variables are shown on Data Log Viewer.</p> <p>[Display Switching (Right/ Left)] Can be used when a data log result file has 10 and more variables. Display is switched by pressing the button.</p> <p>[Select All] Selects all the displayed variables.</p> <p>[Uncheck] Unselects all variables.</p> <p>[Data Log Display] You can go to Data Log Viewer (GraphDisplay) by pressing the button.</p> <p>[Close (X)] Closes the screen.</p>
Graphic	<p>This IAG has one screen.</p> <p>■ Main Screen</p> 

● Screen Specification

Main Screen	A list of variables that logged in the selected data log file.	
User I/F Specification		
No	Part	Description
1	Check Button	Logging variables in data log file are shown in this area. Up to 10 variables are available. You can select them by checking the box.
2	Button	With these buttons, you can switch variables to display. The buttons can be used when 10 and more variables have been logged.
3	Button	Selects all the displayed variables.
4	Button	Unchecks all the selected variables in [1].
5	Button	Enables to jump to GraphDisplay. This button cannot be pressed unless at least one variable has been selected in [1].
6	Button	Closes this screen.
Layout		
Property	Default	Description
Position (Left, Up)		Set in Properties.
Size (Width, Height)		Set in Properties.

● Properties

Property	Description	Input Mode	Input Range/ Data Type	Default
General				
Name	Object name. Must not be overlapped in a screen.	Direct input	Character string (1 to 127)	SelectDataLogParameter0
Type	Object type. Not changeable.	-	-	SafetyCPU_IAG_7inch.SelectDataLogParameter
Version	IAG version	-	-	1.1.0.0
Publisher	IAG publisher	-	-	Omron Promotion Sample
Appearance				
Background Color	Background color of a page	Item selection Direct input	Color pallet Character string	Transparent ¹
Layout				
▼Position (Left , Top)	Position setting of object on a page. ²	Direct input Spin button	Numeric Numeric	-
Left	Horizontal position (X-axis) of the top-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
Top	Vertical position (Y-axis) of the to-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
▼Size (Width, Height)	Object size setting.	Direct input Spin button	Numeric Numeric	(640,420)
Width	Width of object	Direct input Spin button	Numeric Numeric	640
Height	Height of object.	Direct input Spin button	Numeric Numeric	420
Input/Output				
ControllerName	Controller name of connected unit	Variable specification	String(15)	(Blank)
CheckController	Check flag for unit connected with the safety CPU unit.	Variable specification	Boolean(15)	(Blank)
SelectUnitNo	The unit number of the selected unit.	Variable specification	Short	(Blank)
DataLogFileName	File name of the downloaded file.	Variable specification	String	(Blank)
DisplayDataLoggingResult	Parameter information to be graphically displayed.	Variable specification	Str_DataLogResult (structure) ³	(Blank)

Image

▼ General	
Name	SelectDataLogParameter0
Type	SafetyCPU_IAG_7inch.SelectDataLogParameter
Version	1.1.0.0
Publisher	Omron Promotion Sample
▼ Appearance	
BackgroundColor	<input type="checkbox"/> Transparent
▼ Layout	
▼ Position (Left,Top)	
Left	0
Top	0
▼ Size (Width,Height)	
Width	640
Height	420
▼ Behavior (In/Out)	
ControllerName	
CheckController	
SelectUnitNo	
DataLogFileName	
DisplayDataLoggingResult	

1: Transparent.

2: The origin of coordinates locates at the top left corner of NA screen.

3: Refer to Chapter 6 "Structures" for the used structures.



Additional Information


This IAG doesn't have Input property.

- Events & Actions

No event & action function available.

- Animations

Basic motions of animation can be defined.

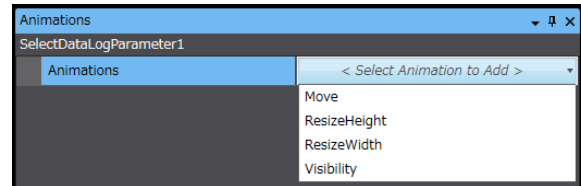

- Security

No security function available.

- Property Assignment


This IAG uses the safety configuration information which has been read out by ReadConfiguration.

Be sure to place ReadConfiguration IAG in the first displayed screen. Assign variables to the following properties (input/output) to share the safety configuration information.

Property (Input/Output)	Description	Data Type
ControllerName	Controller name of connected unit	String(15)
CheckController	Check flag for unit connected with the safety CPU unit.	Boolean(15)
SelectUnitNo	The unit number of the selected unit.	Short

Downloaded data log file names and log results are shared with other IAGs. For that reason, allocate the same variables to the property (input/output) below.


Property (Input/Output)	Description	Data Type
DataLogFileName	File name of the downloaded file.	String
DisplayDataLoggingResult	Information on parameters to display.	Str_DataLogResult (structure)

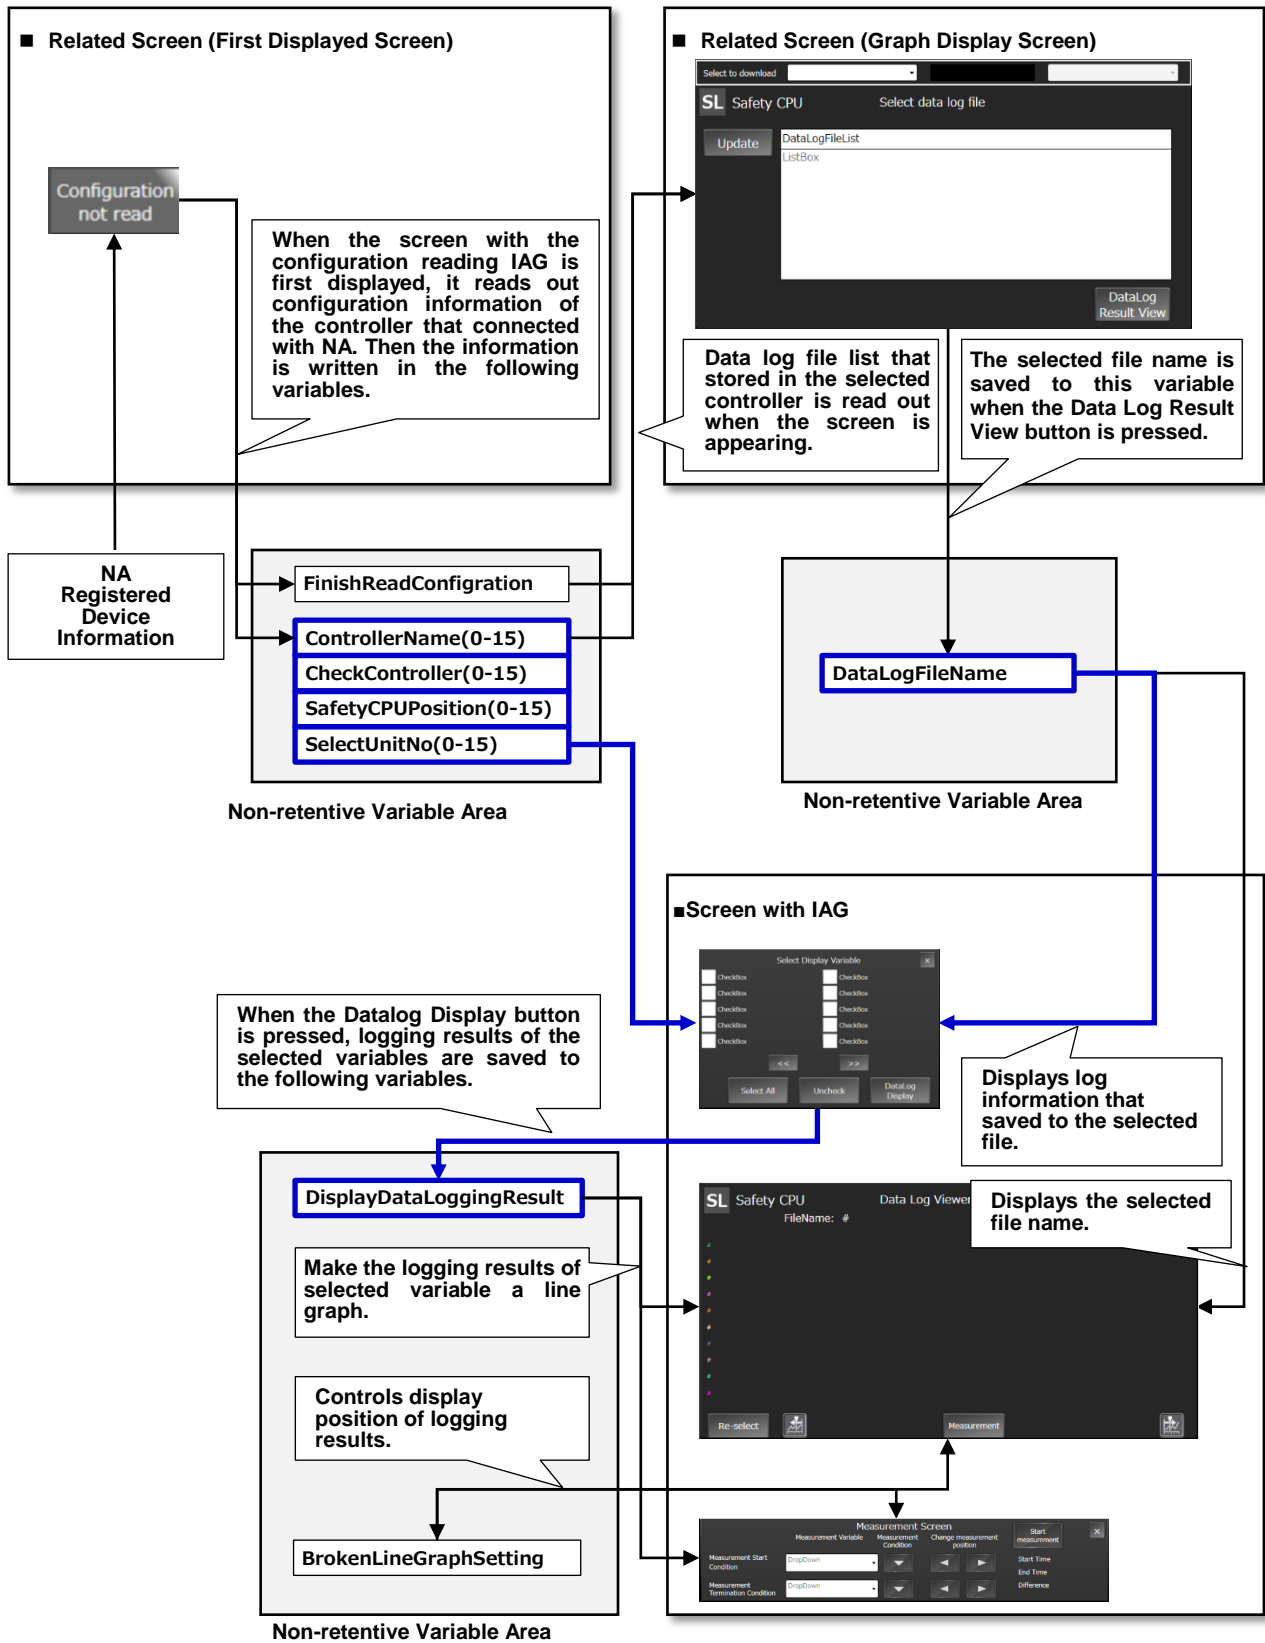

- Screen Name

Screen names used by data log display IAG objects in the table below are fixed because pages are switched inside IAG. Be sure to use IAG objects in the specified pages.


IAG Object Name	Screen Name
DataLogFileView	DataLogFileView
SelectDataLogParameter	ParameterSelect
GraphDisplay	DataTraceGraphView
DataLogResultMeasurement	MeasurementView

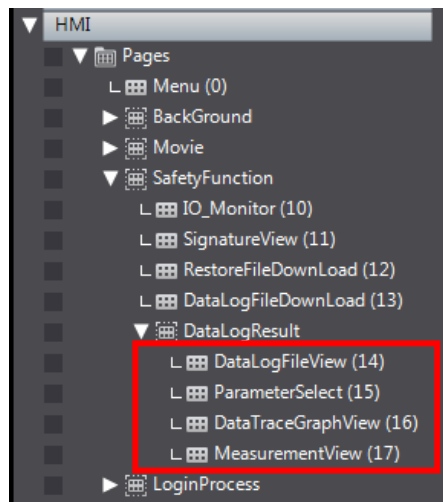

5-8 GraphDisplay

5-8-1 Specifications

- External Specification

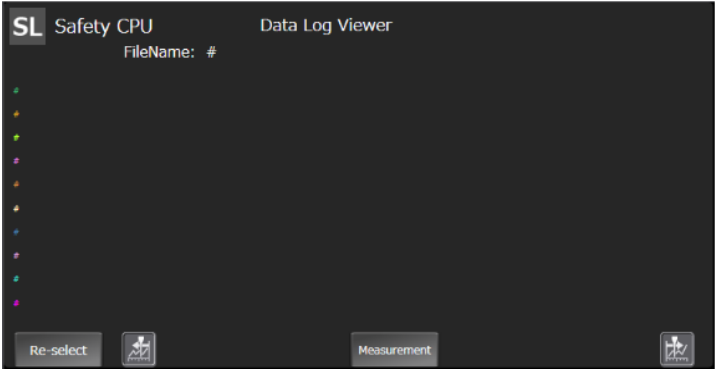Object Name	GraphDisplay
Category	SafetyCPU_DataLogResultViewer
Description	Line graph component is not included in this IAG. Add a line graph component if necessary.
Function	Depicts the results of data logging graphically. Up to 10 data logs can be displayed at the same time. [Move to Right/Left] You can scroll a line graph right or left. [Measurement] Displays DataLogResultMeasurement. [Re-select] You can jump to SelectDataLogParameter.
Graphic	<p>The IAG has one screen.</p> <ul style="list-style-type: none">■ Main Screen 

● Screen Specification

Main Screen	The variables that logged in the selected data log file are displayed in this screen.

User I/F Specification		
No	Part	Description
1	Data Display	Displays the name of selected data log file.
2	Data Display	Selected variable is displayed.
3	Button	Enables to jump to SelectDataLogParameter.
4	Button	Displays DataLogResultMeasurement.
5	Button	You can scroll a data log result graph to left.
6	Button	You can scroll a data log result graph to right.
Layout		
Property	Default	Description
Position (Left, Up)		Set in Properties.
Size (Width, Height)		Set in Properties.

● Properties

Property	Description	Input Mode	Input Range/ Data Type	Default
General				
Name	Object name. Must not be overlapped in a screen.	Direct input	Character string (1 to 127)	GraphDisplay0
Type	Object type. Not changeable.	-	-	SafetyCPU_IAG_7inch.GraphDisplay
Version	IAG version	-	-	1.1.0.0
Publisher	IAG publisher	-	-	Omron Promotion Sample
Appearance				
Background Color	Background color of a page	Item selection Direct input	Color pallet Character string	Transparent ¹
Layout				
▼Position (Left , Top)	Position setting of object on a page. ²	Direct input Spin button	Numeric Numeric	-
Left	Horizontal position (X-axis) of the top-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
Top	Vertical position (Y-axis) of the to-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
▼Size (Width, Height)	Object size setting.	Direct input Spin button	Numeric Numeric	(780,390)
Width	Width of object	Direct input Spin button	Numeric Numeric	780
Height	Height of object.	Direct input Spin button	Numeric Numeric	390
Input/Output				
DataLogFileName	File name of the downloaded file.	Variable specification	String	(Blank)
DisplayDataLoggingResult	Parameter information to be graphically displayed.	Variable specification	Str_DataLogResult (structure) ³	(Blank)
BrokenLineGraphSetting	Control information about displayed line graph component.	Variable specification	Str_BrokenLineGraphSetting (structure) ³	(Blank)

Image

▼ General	
Name	GraphDisplay0
Type	SafetyCPU_IAG_7inch.GraphDisplay
Version	1.1.0.0
Publisher	Omron Promotion Sample
▼ Appearance	
BackgroundColor	<input type="checkbox"/> Transparent
▼ Layout	
▼ Position (Left,Top)	0, 0
Left	0
Top	0
▼ Size (Width,Height)	780, 390
Width	780
Height	390
▼ Behavior (In/Out)	
DataLogFileName	
DisplayDataLoggingResult	
BrokenLineGraphSetting	

1: Transparent.

2: The origin of coordinates locates at the top left corner of NA screen.

3: Refer to Chapter 6 "Structures" for the used structures.



Additional Information


This IAG doesn't have Input property.

- Events & Actions

No event & action function available.

- Animations

Basic motions of animation can be defined.

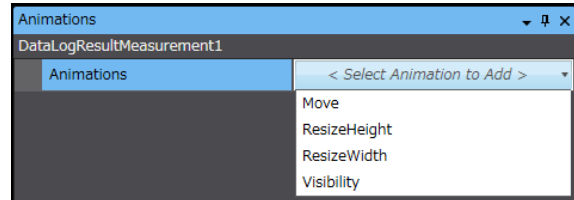

- Security


No security function available.

- **Property Assignment**

This IAG uses the safety configuration information which has been read out by ReadConfiguration.

Be sure to place ReadConfiguration IAG in the first displayed screen. Assign variables to the following properties (input/output) to share the safety configuration information.


Property (Input/Output)	Description	Data Type
DataLogFileName	File name of the downloaded file.	String
DisplayDataLoggingResult	Parameter information to be graphically displayed.	Str_DataLogResult (structure)
BrokenLineGraphSetting	Control information about displayed line graph component.	Str_BrokenLineGraphSetting (structure)

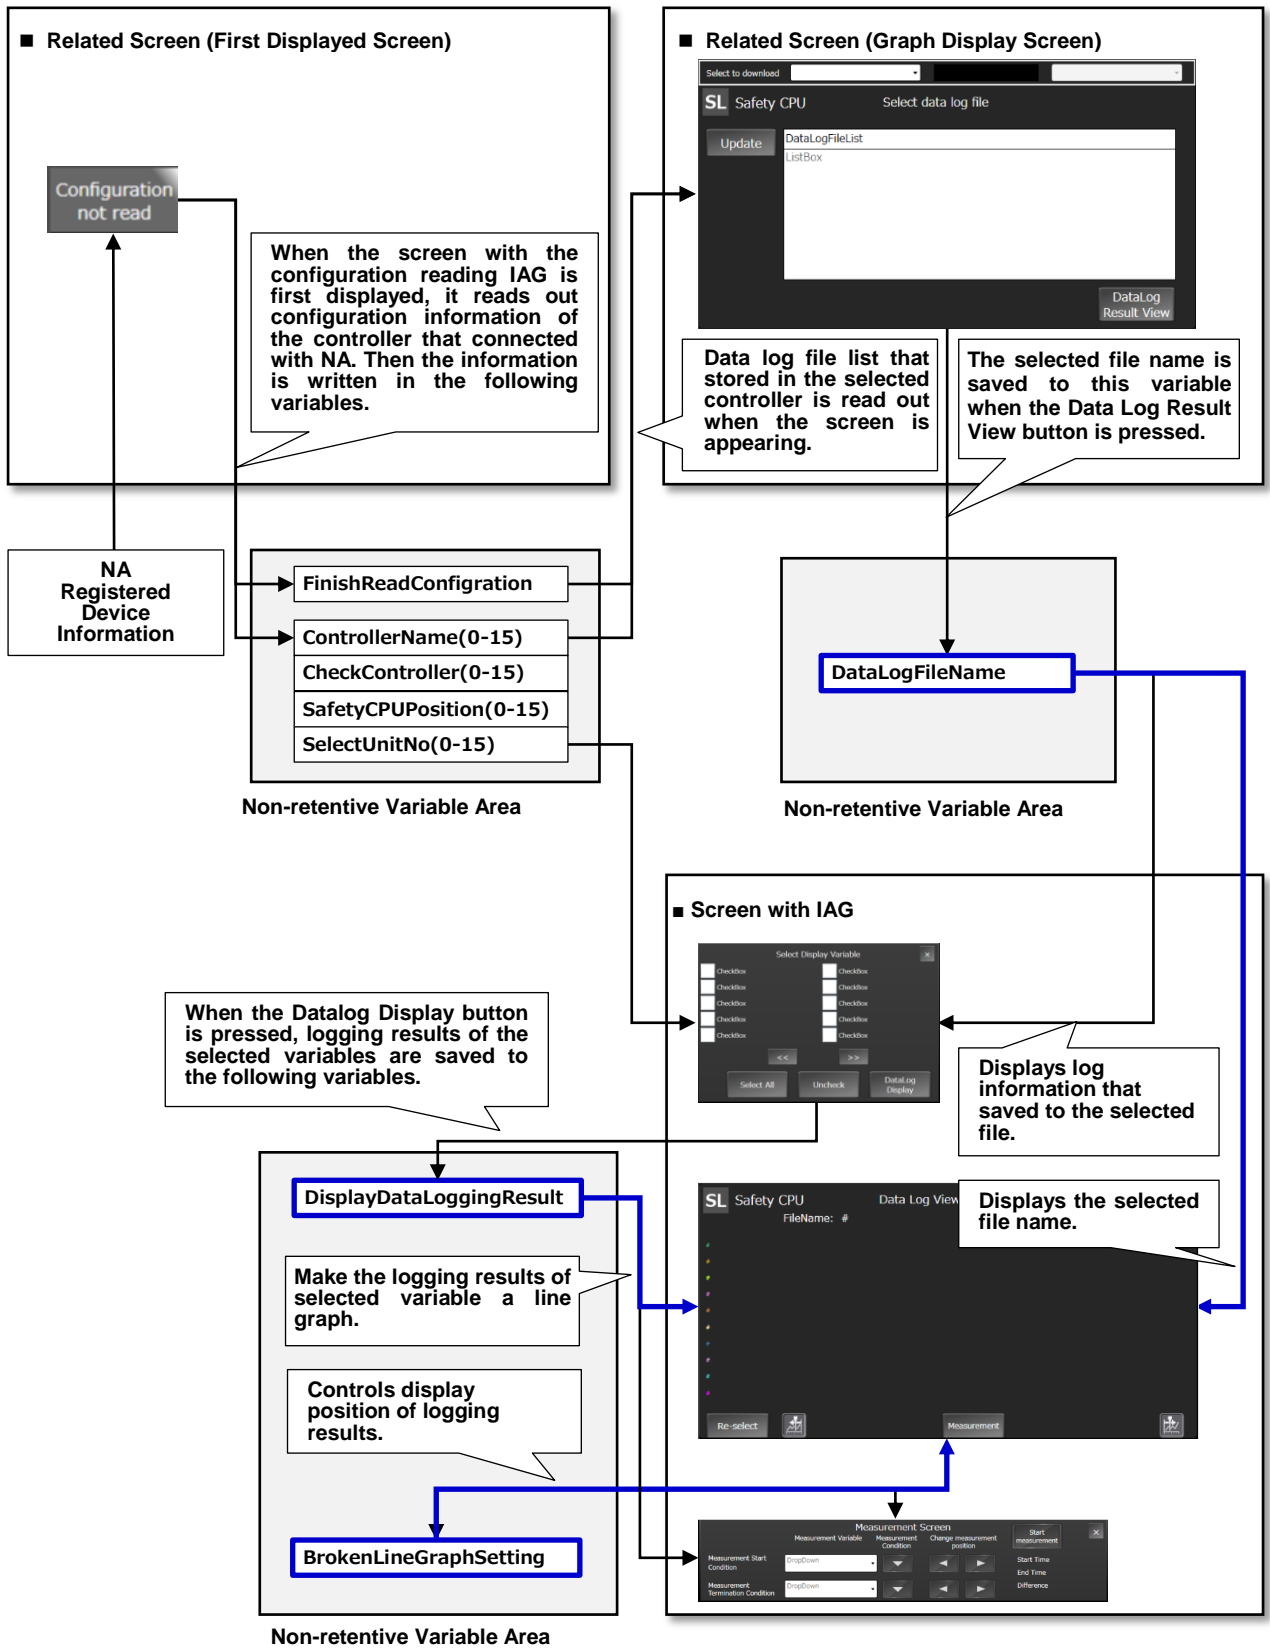

- Screen Name

Screen names used by data log display IAG objects in the table below are fixed because pages are switched inside IAG. Be sure to use IAG objects in the specified pages.

IAG Object Name	Screen Name
DataLogFileView	DataLogFileView
SelectDataLogParameter	ParameterSelect
GraphDisplay	DataTraceGraphView
DataLogResultMeasurement	MeasurementView

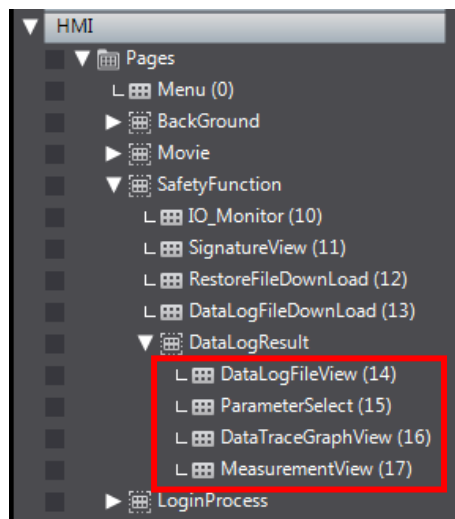

● Data Group Registration


You must register a Data Group if you want to add a line graph component. The setting procedure for the data group is described below.

1. Register a global variable and data type in advance, referring to *DisplayDataLoggingResult*, which is the property of this IAG object.


Name:
DataLogResult
Data Type:
Str_DataLogResult

Name	Data Type	Initial Value	AT	Retain	Constant	Update Rate	Scaling	Comment
DataLogResult	Str_DataLogResult					None	None	


2. Right-click [HMI] – [Data Group] in Multiview Explorer. Then Click [Add] – [Data Group].

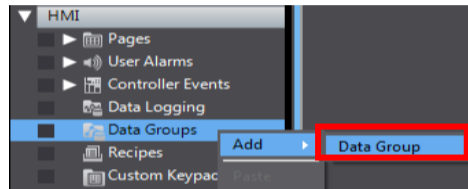


3. Double-click the newly added data group.

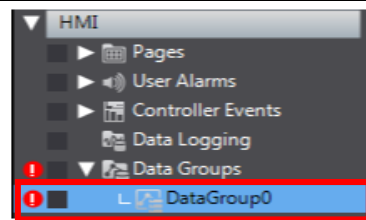


4. Click the [+] button to create the data to be graphically displayed.

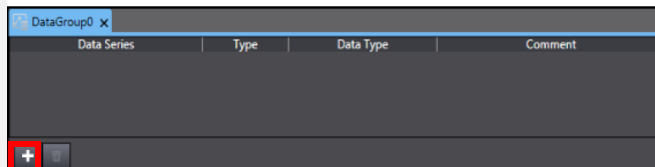

5. Enter a name in Data Series box. Then enter the following values in Type and Data Type:
Type = Array
Data Type = Ushort

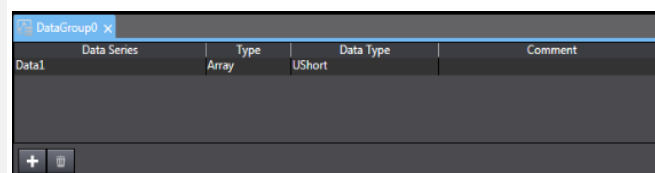

6. Enter “DataLogResult.DataLoggingData” in the Variable box. Then set Target Dimension and Target Index.

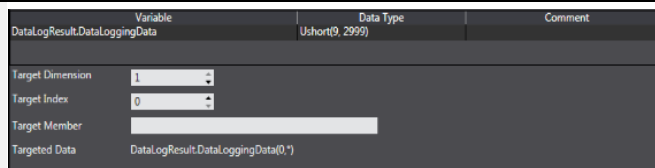

7. Click the [+] button to add as many data series as necessary traces.

Data Series	Type	Data Type	Comment
Data1	Array	UShort	
Data2	Array	UShort	
Data3	Array	UShort	
Data4	Array	UShort	
Data5	Array	UShort	

8. The setting after placing line graph component is described here. First, enter a data group name.

▼ Data

DataGroup	<input type="text"/>
Offset	0
Traces	0 +

9. Click the [+] button in Traces. Assign the data series which have been set in Data Group. You can set items such as Color.

▼ Data

DataGroup	DataGroup0
Offset	0
Traces	1 +
▼ [0]	trace0 : Data1 ⊞
Name	trace0
DataSeries	Data1
ScaleAssociation	Left Scale
Color	■ LightBlue
MarkerType	None

10. Repeat the Step9 to display multiple data in line graphs.


▼ Data

DataGroup	CSVLogData
Offset	BrokenLineGraphSetting.Offset
Traces	10 +
▶ [0]	trace0 : Data1 ⊞
▶ [1]	trace1 : Data2 ⊞
▶ [2]	trace2 : Data3 ⊞
▶ [3]	trace3 : Data4 ⊞
▶ [4]	trace4 : Data5 ⊞
▶ [5]	trace5 : Data6 ⊞
▶ [6]	trace6 : Data7 ⊞
▶ [7]	trace7 : Data8 ⊞
▶ [8]	trace8 : Data9 ⊞
▶ [9]	trace9 : Data10 ⊞

5-9 DataLogResultMeasurement

5-9-1 Specifications

- External Specification

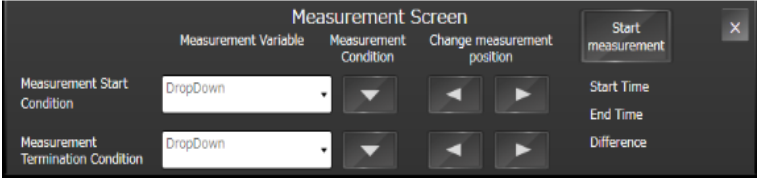Object Name	DataLogResultMeasurement
Category	SafetyCPU_DataLogResultViewer
Description	This IAG picks up the two variables among the tracing results which are displayed on GraphDisplay. Then measures the time between the two points to display.
Function	<p>Measures data log results.</p> <p>[Start Measurement] Begins to measure.</p> <p>[Measurement Condition (Rising)] Specifies the rising point of selected variable as the condition to measure start/end position.</p> <p>[Measurement Condition (Falling)] Specifies the falling point of selected variable as the condition to measure start/end position.</p> <p>[Search Trigger Condition (Forward/ Back)] Moves to the trigger which satisfies conditions, searching forward or backward from the currently selected trigger.</p> <p>[Close] Closes the screen.</p>
Graphic	<p>The IAG has one screen.</p> <ul style="list-style-type: none"> ■ Main Screen 

● Screen Specification

Main Screen	You can measure the elapsed periods of time for the two triggers of the displayed variable.	
User I/F Specification		
No	Part	Description
1	Drop Down	You can select the variable of the condition for starting measurement here.
2	Drop Down	You can select the variable of the condition for stopping measurement here.
3	Button	Enables to select a condition for starting measurement: rising or falling.
4	Button	Enables to select a condition for stopping measurement: rising or falling.
5	Button	Searches forward the point that satisfies trigger condition from where currently triggered by measurement start condition.
6	Button	Searches forward the point that satisfies trigger condition from where currently triggered by measurement stop condition.
7	Button	Searches backward the point that satisfies trigger condition from where currently triggered by measurement start condition.
8	Button	Searches backward the point that satisfies trigger condition from where currently triggered by measurement stop condition.
9	Button	Starts to measure.
10	Data Display	Shows the time that fills trigger condition for starting measurement.
11	Data Display	Shows the time that fills trigger condition for stopping measurement.
12	Data Display	Displays a difference between start time and end time of measurement.
13	Button	Closes the screen.
Layout		
Property	Default	Description
Position (Left, Up)		Set in Properties.
Size (Width, Height)		Set in Properties.

● Properties

Property	Description	Input Mode	Input Range/ Data Type	Default
General				
Name	Object name. Must not be overlapped in a screen.	Direct input	Character string (1 to 127)	DataLogResultMeasurement0
Type	Object type. Not changeable.	-	-	SafetyCPU_IAG_7inch.DataLogResultMeasurement
Version	IAG version	-	-	1.1.0.0
Publisher	IAG publisher	-	-	Omron Promotion Sample
Appearance				
Background Color	Background color of a page	Item selection Direct input	Color pallet Character string	Transparent ¹
Layout				
▼Position (Left , Top)	Position setting of object on a page. ²	Direct input Spin button	Numeric Numeric	-
Left	Horizontal position (X-axis) of the top-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
Top	Vertical position (Y-axis) of the to-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
▼Size (Width, Height)	Object size setting.	Direct input Spin button	Numeric Numeric	(800,160)
Width	Width of object	Direct input Spin button	Numeric Numeric	800
Height	Height of object.	Direct input Spin button	Numeric Numeric	160
Input/Output				
DisplayDataLoggingResult	Parameter information to be graphically displayed.	Variable specification	Str_DataLogResult (structure) ³	(Blank)
BrokenLineGraphSetting	Control information about displayed line graph component.	Variable specification	Str_BrokenLineGraphSetting (structure) ³	(Blank)

Image

▼ General	
Name	DataLogResultMeasurement0
Type	SafetyCPU_IAG_7inch.DataLogResultMeasurement
Version	1.1.0.0
Publisher	Omron Promotion Sample
▼ Appearance	
BackgroundColor	<input type="checkbox"/> Transparent
▼ Layout	
▼ Position (Left,Top)	
Left	0, 0
Top	0
▼ Size (Width,Height)	
Width	800, 160
Height	800
Height	160
▼ Behavior (In/Out)	
DisplayDataLoggingResult	
BrokenLineGraphSetting	

1: Transparent.

2: The origin of coordinates locates at the top left corner of NA screen.

3: Refer to Chapter 6 "Structures" for the used structures.



Additional Information


This IAG doesn't have Input property.

- Events & Actions

No event & action function available.

- Animations

Basic motions of animation can be defined.

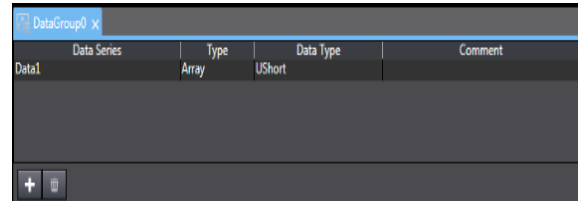

Data Series	Type	Data Type	Comment
Data1	Array	UShort	


- Security

No security function available.

- Property Assignment

Assign the same variables to the following properties (input/output) to share the logging results and line graph configuration information with other IAGs.


Property (Input/Output)	Description	Data Type
DisplayDataLoggingResult	Parameter information to be graphically displayed.	Str_DataLogResult (structure)
BrokenLineGraphSetting	Control information about displayed line graph component.	Str_BrokenLineGraphSetting (structure)

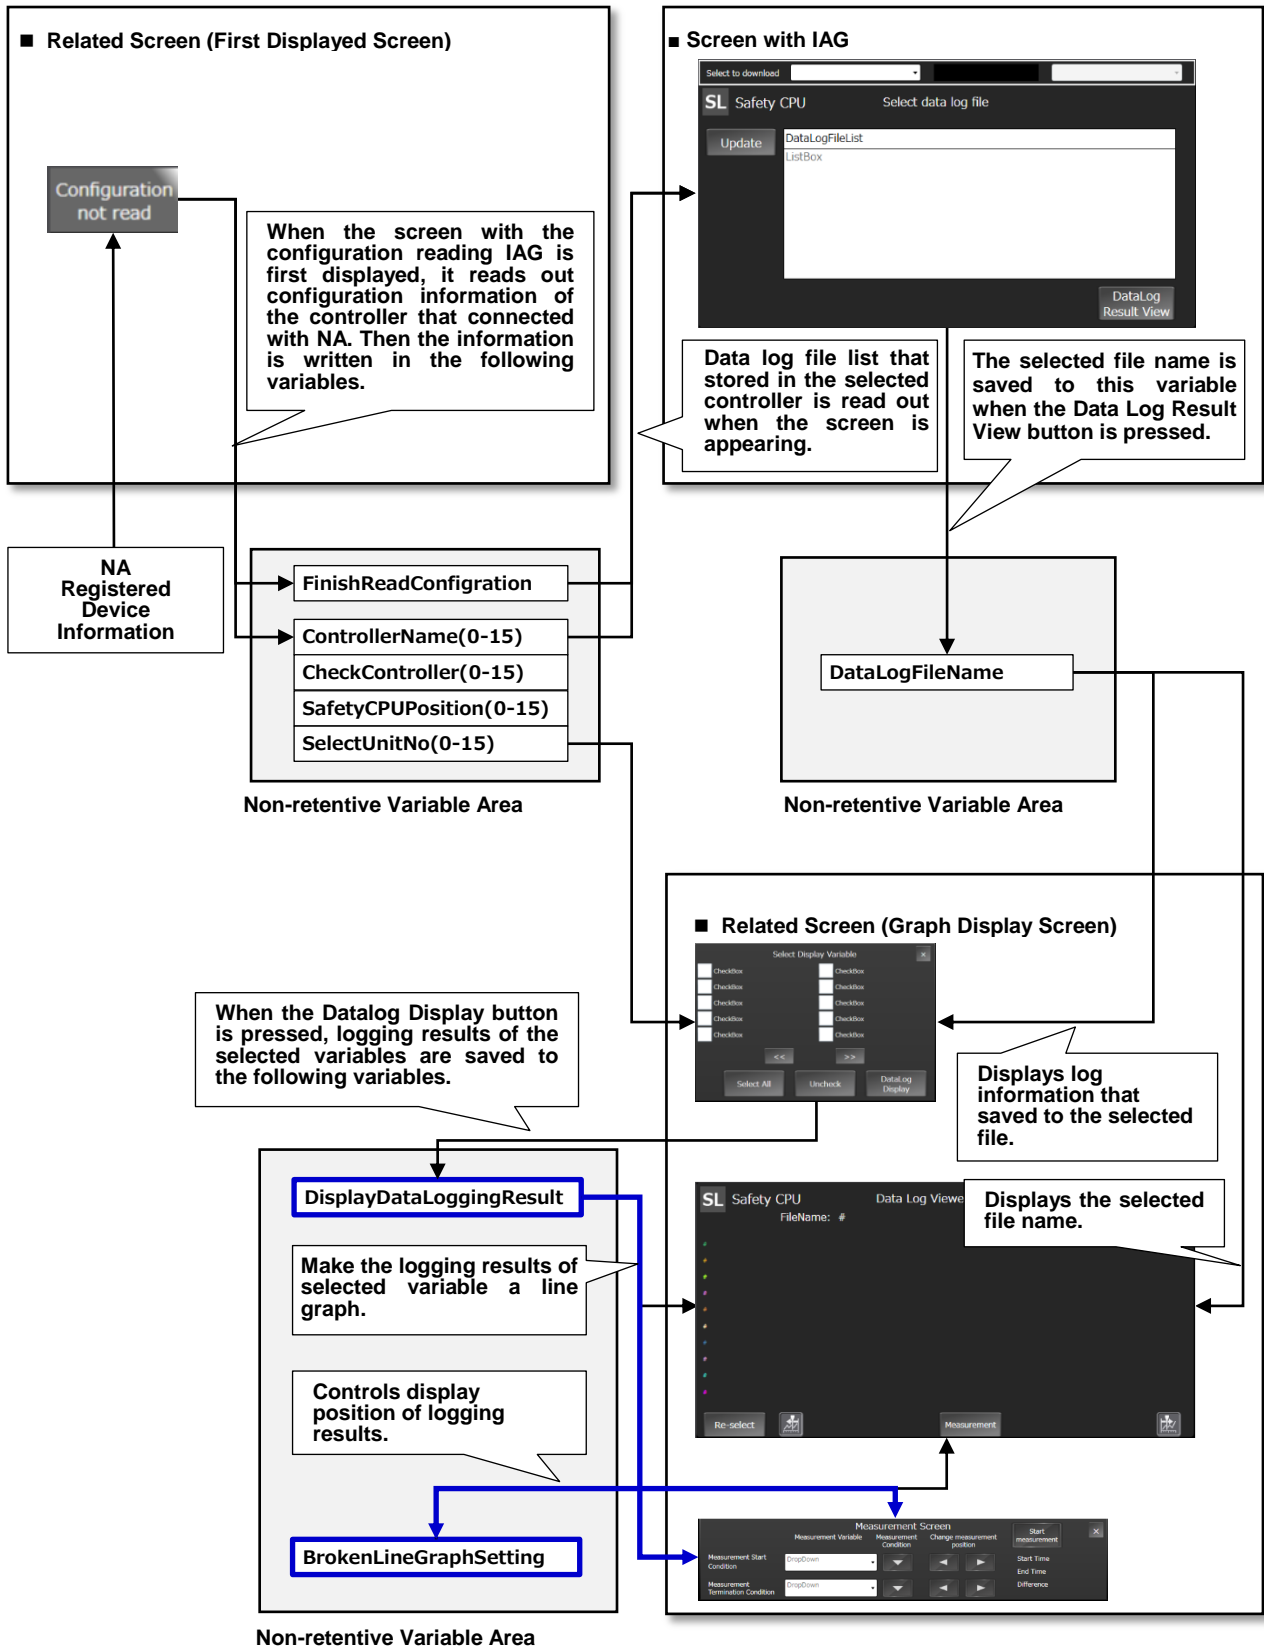

- Screen Name

Screen names used by data log display IAG objects in the table below are fixed because pages are switched inside IAG. Be sure to use IAG objects in the specified pages.

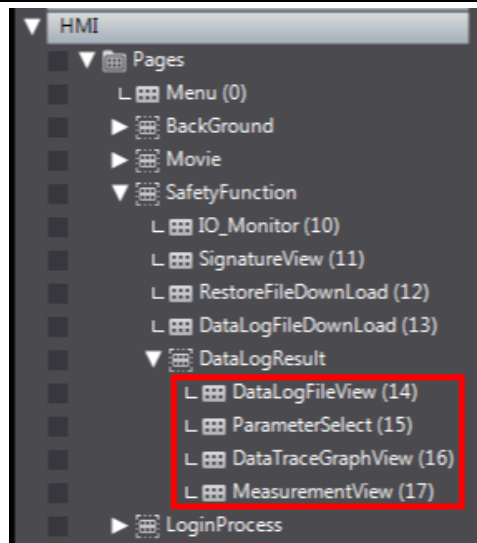

IAG Object Name	Screen Name
DataLogFileView	DataLogFileView
SelectDataLogParameter	ParameterSelect
GraphDisplay	DataTraceGraphView
DataLogResultMeasurement	MeasurementView



5-10 Troubleshooter


5-10-1 Specifications

● External Specification

Object Name	TroubleShooter
Category	SafetyCPU_TroubleShooter
Description	This IAG enables you to jump to the troubleshooter screen of the connected controller.
Function	Displays the troubleshooter of the safety CPU unit.
Graphic	Normal 
	Press 

● Properties

Property	Description	Input Mode	Input Range/ Data Type	Default
General				
Name	Object name. Must not be overlapped in a screen.	Direct input	Character string (1 to 127)	TroubleShooter0
Type	Object type. Not changeable.	-	-	SafetyCPU_IAG_7inch.TroubleShooter
Version	IAG version	-	-	1.0.0.0
Publisher	IAG publisher	-	-	Omron Promotion Sample
Appearance				
Background Color	Background color of a page	Item selection Direct input	Color pallet Character string	Transparent ¹
Layout				
▼Position (Left , Top)	Position setting of object on a page. ²	Direct input Spin button	Numeric Numeric	-
Left	Horizontal position (X-axis) of the top-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
Top	Vertical position (Y-axis) of the to-left corner of an object on a page.	Direct input Spin button	Numeric Numeric	-
▼Size (Width, Height)	Object size setting.	Direct input Spin button	Numeric Numeric	(40,40)
Width	Width of object	Direct input Spin button	Numeric Numeric	40
Height	Height of object.	Direct input Spin button	Numeric Numeric	40
Input				
FinishReadController	Completion flag for configuration reading	Variable specification	Boolean	(Blank)
Input/Output				
ControllerName	Controller name of connected unit	Variable specification	String(15)	(Blank)
CheckController	Check flag for unit connected with the safety CPU unit.	Variable specification	Boolean(15)	(Blank)
SelectUnitNo	The unit number of selected unit.	Variable specification	Short	(Blank)

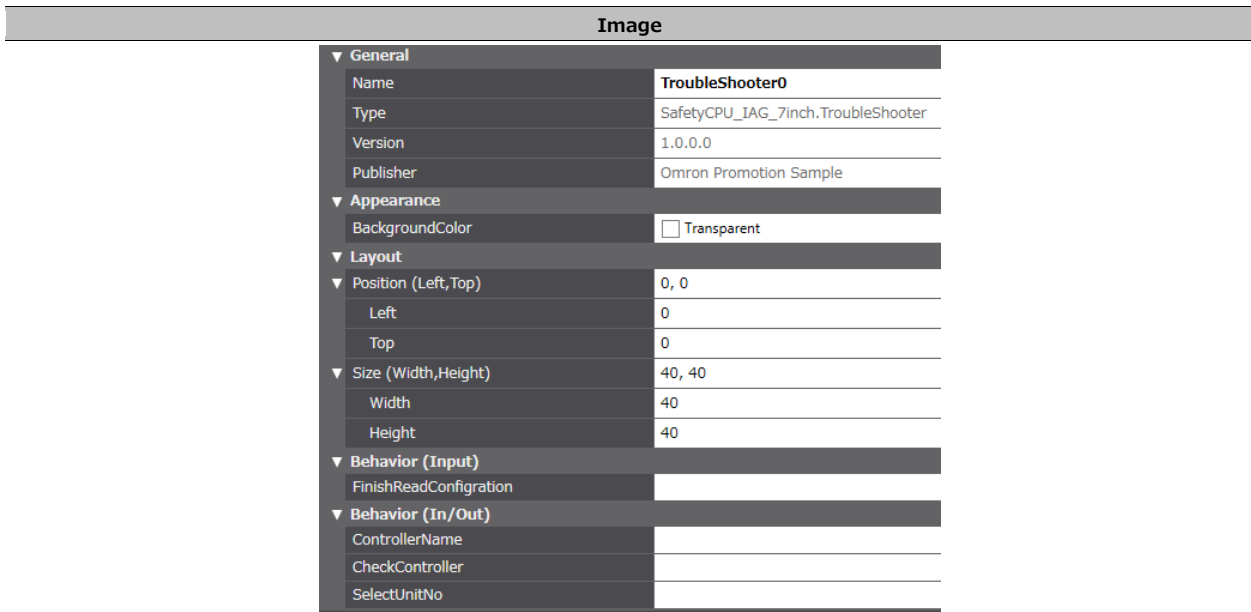

1: Transparent.


2: The origin of coordinates locates at the top left corner of NA screen.

- Events & Actions

No event & action function available.

- Animations

Basic motions of animation can be defined.

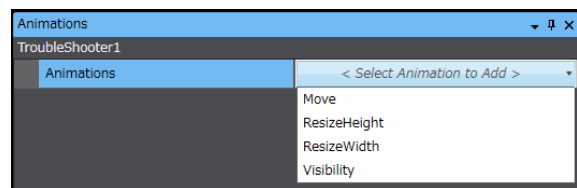

- Security

No Security function available.


● Property Assignment

This IAG uses the safety configuration information which has been read out by ReadConfiguration.

Be sure to place ReadConfiguration IAG in the first displayed screen. Assign variables to the following properties (input/output) to share the safety configuration information

Property (Input)	Description	Data Type
FinishReadConfiguration	Completion flag for configuration reading	Boolean

Property (Input/Output)	Description	Data Type
ControllerName	Controller name of connected unit	String(15)
CheckController	Check flag for unit connected with the safety CPU unit.	Boolean(15)
SelectUnitNo	The unit number of selected unit.	Short

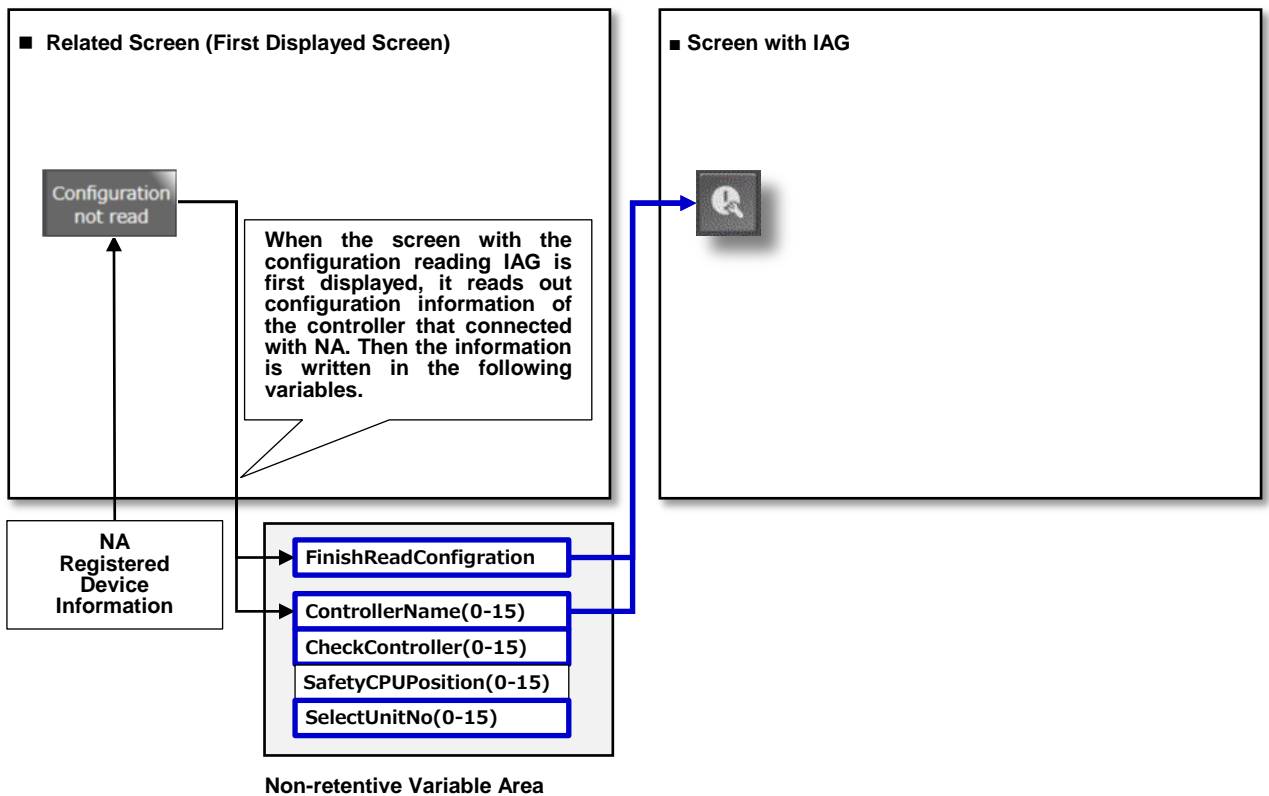

6 Structures

Category	Name	Data Type	Remarks
Structure	Str_DataLogResult	STRUCT	Structure to store data logging results.
Member	ParameterCount	Short	Number of selected variables.
Member	ParameterName	String(9)	Name of selected variable.
Member	DataLogTimeStamp	String(2999)	Timestamp of selected data log.
Member	DataLoggingData	Ushort(9, 2999)	Logging results of selected data log.

Category	Name	Data Type	Remarks
Structure	Str_BrokenLineGraphSetting	STRUCT	Structure to control line graphs of data tracing results.
Member	Offset	Integer	Offset value on time axis.
Member	BrokenGraphXAxisMinValue	Single	Minimum value on time axis.
Member	BrokenGraphXAxisMaxValue	Single	Maximum value on time axis.

Revision History

Revision Code	Date	Revision Description
01	February 2019	Original production
02	May 2019	Added new functions

OMRON Corporation Industrial Automation Company

Tokyo, JAPAN

Contact: www.ia.omron.com

Regional Headquarters

OMRON EUROPE B.V.

Wegalaan 67-69, 2132 JD Hoofddorp
The Netherlands

Tel: (31)2356-81-300/Fax: (31)2356-81-388

OMRON ELECTRONICS LLC

2895 Greenspoint Parkway, Suite 200
Hoffman Estates, IL 60169 U.S.A

Tel: (1) 847-843-7900/Fax: (1) 847-843-7787

OMRON ASIA PACIFIC PTE. LTD.

No. 438A Alexandra Road # 05-05/08 (Lobby 2),
Alexandra Technopark,
Singapore 119967

Tel: (65) 6835-3011/Fax: (65) 6835-2711

OMRON (CHINA) CO., LTD.

Room 2211, Bank of China Tower,
200 Yin Cheng Zhong Road,
PuDong New Area, Shanghai, 200120, China

Tel: (86) 21-5037-2222/Fax: (86) 21-5037-2200

Authorized Distributor:

© OMRON Corporation 2019 All Rights Reserved.
In the interest of product improvement,
specifications are subject to change without notice.

Cat. No. V448-E1-02

0519(0219)